



Life-Cycle Cost Analysis of an Installed Multiunit Seasonal Thermal Energy Store

Colclough, S., Hewitt, N., & Griffiths, P. (2017). Life-Cycle Cost Analysis of an Installed Multiunit Seasonal Thermal Energy Store. *Journal of Energy and Power Engineering*, 11, 439-445.
<http://uir.ulster.ac.uk/38045/2/Colclough%20Shane%20Financial%20analysis%20of%20an%20installedmultiunit%20seasonal%20thermal%20energy%20store.docx>

[Link to publication record in Ulster University Research Portal](#)

Published in:

Journal of Energy and Power Engineering

Publication Status:

Published (in print/issue): 31/07/2017

Document Version

Author Accepted version

General rights

Copyright for the publications made accessible via Ulster University's Research Portal is retained by the author(s) and / or other copyright owners and it is a condition of accessing these publications that users recognise and abide by the legal requirements associated with these rights.

Take down policy

The Research Portal is Ulster University's institutional repository that provides access to Ulster's research outputs. Every effort has been made to ensure that content in the Research Portal does not infringe any person's rights, or applicable UK laws. If you discover content in the Research Portal that you believe breaches copyright or violates any law, please contact pure-support@ulster.ac.uk.

Financial analysis of an installed multiunit seasonal thermal energy store

S.Colclough, NJ Hewitt, P Griffiths. Ulster University, Newtownabbey, Northern Ireland, UK
Corresponding Author S.Colclough@ulster.ac.uk, Tel 00442890366907

Abstract

The financial viability of a solar Seasonal Thermal Energy Store (STES) installed in a mixed commercial and residential multiunit development of low-energy buildings located in Lysekil, Sweden, a maritime Scandinavian Climate has been investigated. Using recorded figures for the installation costs and performance, a financial Life Cycle Analysis has been undertaken to determine the cost effectiveness of the system.

The time value of money is considered and a Life Cycle Cost (LCC) analysis undertaken to identify the cost-effectiveness of the solution. It shows that while a direct heating and hot water system incorporating STES can be economically viable in a Swedish Maritime Climate in the long term, assistance such as that provided by government incentives is required to assist with the high capital cost of the initial investment.

1.0 Introduction and description of installation.

Regulations, such as those mandated as a result of the EU's Energy Performance of Buildings Directive (Anon, 2013a), are seeking to significantly reduce the space heating demand of dwellings while increasing the use of renewables to meet the residual energy demand. The study of the performance of houses (Schnieders & Hermelink, 2006) complying with the low energy Passivhaus standard (Anon 2013b) provides an insight into the performance of the now mandated low-energy buildings of the future. A number of studies have documented the performance of the Passivhaus dwelling in various climates (Badescu et al, 2013; Guerra-Santin al 2013; Ridley et al, 2013; Colclough, 2011).

The falling prices of solar collectors, allows for additional solar collectors to be added at minimal extra cost thereby significantly increasing the DHW and space heating solar fraction (SF) of low-energy buildings, reducing significantly the carbon derived energy demand. Surplus heat generated in summer can be fed to a Seasonal Thermal Energy Store (STES) potentially allowing surplus summer heat to be used in the winter (Hadron, 2005). However, while much has been written on large communal STES (e.g. DINCER, I. & ROSEN, 2002) and to a lesser extent single dwelling STES, (e.g. Griffiths & Colclough 2015) consideration also needs to be given to STES for small multiuse schemes.

In addition, while papers have focused on the analysis of STES systems in combination with low Energy houses through the use of dynamic building simulation software, (Badescu & Staicovici, 2006; Leckner & Zmeureanu, 2011; Hugo & Zmeureanu 2013, Clarke et al 2013), a number of which also undertook financial analysis, few examples exist of a financial analysis based on recorded costs and monitored performance of an installation. The approach used in Colclough & Griffiths (2016) is used in this paper to carry out such an analysis of the financial viability of a

space heating and DHW solar thermal installation utilising STES for a multiuse development complying with the Passivhaus standard in a Swedish maritime climate based on the recorded data.

An existing 381m² building “Building 1” comprising four shop units and two two bedroom apartments has been renovated to standards approaching the Passive House Enerphit standard. In addition, a newbuild two-storey 390m² building “Building 2“ has been built to the Passive House standard and a 23m³ Seasonal Thermal Energy Store (STES) installed in its basement.

Space and domestic hot water (DHW) heating is provided by means of a district heating system in combination with a solar system. See fig. 1 for a schematic of the wet heating system.

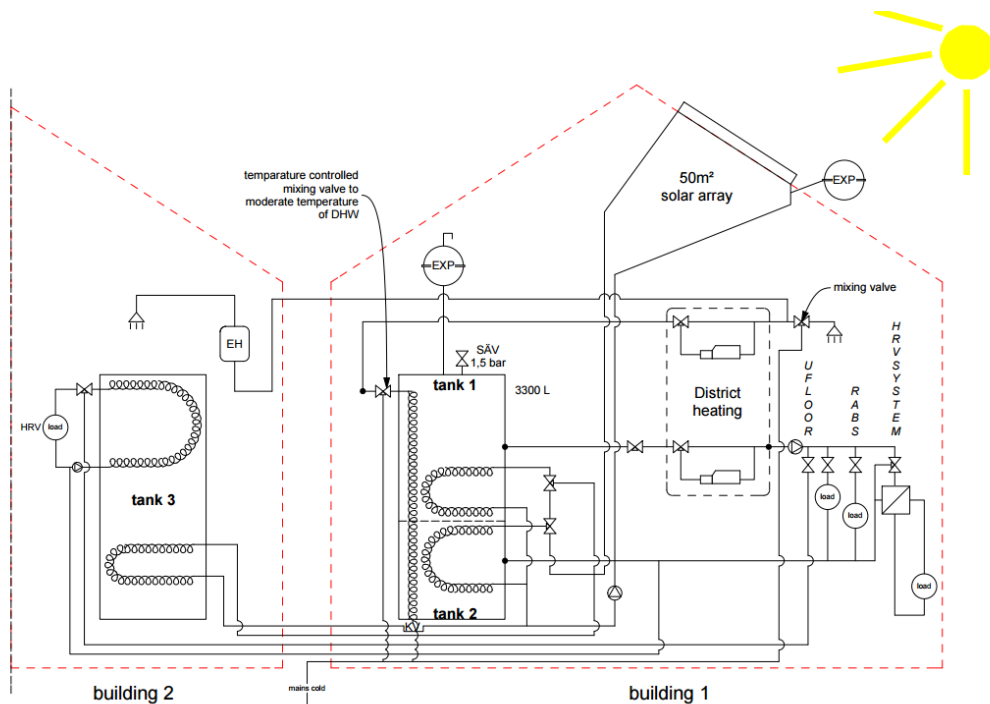


Fig. 1 Schematic of Wet Heating System

The 50 m² solar array comprises 10 panels of 1.8 m² aperture (totalling 18 m²) of evacuated tube collectors and 16 panels of 2 m² aperture, (totalling 32 m²) of flat plate collectors. A 3300 L buffer tank located in building one is logically divided into two based on thermal stratification considerations. The solar collectors supply heat to the heat exchanger coil in the middle of the buffer tank (“tank 1“) or heat exchanger coil at the bottom of the buffertank (“tank 2“). Heat excess to the requirements of the buffer tank is fed to the Seasonal Thermal Energy Store (tank 3) located in the existing basement of building two.

The location of the STES in the unused and unheated basement of building two reduces the costs typically associated with STES such as excavation costs and the costs associated with protecting the STES from water ingress from the surrounding soil. Further, the space used in the basement is the result of constructing the dwelling on a sloping site. The basement has a varying height from 2.1 m (where the STES is located) to less than 30 cm, in order to provide a level platform for the three-storey building above. Thus there are no additional costs associated with the siting of the

STES. Finally, costs are further reduced by purchasing a previously used tank, leading to a highly cost-effective STES installation.

2.0 Theory and approach

2.1 Overview - Life Cycle Cost and Savings Analysis

Life-cycle cost analysis is a tool used to determine the most cost-effective option among different competing alternatives for a project, when each is equally appropriate to be implemented on technical grounds. All costs are usually discounted and totalled to a present day value known as the net present value (NPV) using a discount factor d , bringing costs to their present day value.

A 40 year period has been chosen for this analysis given the significant capital investment costs required for the seasonal thermal energy store and the long service life of the STES. The STES is considered to be part of the energy infrastructure of the dwelling in the same way as appropriate orientation, insulation and airtightness. The analysis does not consider the cost of financing the investment, tax incentives or annual corporate tax treatments.

2.2 Expected Life of the Equipment

Given that solar thermal is a mature technology, the various components carry long warranties and it is anticipated that with minimal intervention, systems will continue to operate for 15 to 40 years. Cost has been allocated for scheduled maintenance of the system every six years, in line with the maintenance schedule carried out at the installation, and it is assumed that the solar thermal system will continue to operate for 20 years with no further investment and that the value of all equipment at the end of the 20 year period is zero. In the case for the installation in Lysekil, the STES tank was purchased second-hand, at a considerable discount compared with the purchase of a similar tank new.

For this reason, it is assumed that the STES tank will also require replacement at the same time as the complete system was overhauled at a cost the same as was initially incurred. In addition, in order to reduce complications in the analysis it is assumed that the Combi system will also be required to be replaced within the 20 year period. The approach of replacing all equipment 20 year period is considered a prudent but conservative financial approach.

2.3 Capital costs

The capital costs are outlined in fig 2. It is assumed that the capital costs of the district heating (DH) system is zero as a district heating space heating system is necessary in order to provide backup for the solar installation in respect of both space heating and DHW. Thus, the capital costs of the installed district heating system are eliminated from the solar and district heating cost analyses. In addition, it is assumed in the analysis that an existing HRV System and underfloor heating system is available as a heat delivery mechanism and therefore an extra heat transport mechanism is not required.

2.4 Operational Costs

It is assumed that a maintenance check is carried out and a glycol solution is added to the water in the solar circuit every six years. It is assumed that this costs €150 (at today's prices).

In order to estimate the costs involved in an overhaul of the system, a cost equivalent to the full system cost of the DHW and HRV System, including replacement of the solar panels, combisystem tank and STES tank is allocated to year 20, and multiplied by the appropriate inflation conversion and Net Present Value (NPV) factors, resulting in a cost allocation of €37,652 in year 20. Thereafter,

the six yearly maintenance interval continues to be scheduled, with the first scheduled maintenance intervention occurring six years after system overhaul.

The annual running costs in addition to the capital costs are also included. From measurements conducted at the site, it is known that the underfloor/HRV System heating pumps in building 1 consumes 155kWh of electricity annually and 78 kWh in building 2 in distributing heat from the district heating/solar system, and 17 kWh when distributing heat from the STES. The combined 250kWh is negligible when compared with the 60839 kWh of energy consumed in heating building 1 and two over the period. In addition, the 5050 kWh electricity used for space heating and DHW heating is also relatively minor. Nonetheless, the energy costs of electricity are considered separately from the energy costs of the district heating, and are included in the overall financial analysis.

Cost of Building 1 solar Heating System Kungsgatan Lysekil							
Item	Descr.	Suppl	€ / kr rate: 9.1		15/09/2015		Tot Kr
			Price €	Amount	Price ea Kr		
Collector Vacuum U-tube 1.8m2 X 10= 18m2	TZ 47/1500-20U 011-7S162_R 2,5 liter liquid	Sunking Sept 2011	5,275	10	4,800	48,000	
Collector Flat plate 2m2 x 16= 32m2		Sunking Sept 2011	7,033	16	4,000	64,000	
Controller	Steca TR 0603mc	Steca	136	1	1,242	1,242	
Pumpstation:	Steca Solar DN25 TPA-25 +TPAF-25+WILO ST25/7	Steca	270	1	2,454	2,454	
Flow Meter	Steca TA VM1 Flow Meter DS	Steca	229	4	522	2,087	
Sensor:	PT 1000		1,099	10	1,000	10,000	
VEAB ductheater 0.29 lit in pipe	CWW 160-2-2,5	VEAB	1,582	12	1,200	14,400	
Thermostatic regulating valve	Duco mixautomat	EO	44	1	400	400	
3-way motorized valve Wege-Motor-Umschaltventil		EO	396	3	1,200	3,600	
Expansionvessel solar max 10bar	80 lit	Sol & energiteknik	151	2	686	1,372	
Automatic aeriator valve for top position	LK aut airvent 740	EO	11	1	100	100	
Propylenglukol konc.	25 lit	Sol & energiteknik	182	2	828	1,656	
Internal tank (tank 1)	3300 lit w 13 coils x 15m finned cu-pipes 22mm Cuporo	Husqvarna tanksvets	7,651	1	69,625	69,625	
Labour to install tank 1, culvert, pipes, install solar panels, all inside and out +		F&G, EO	12,914	1	117,520	117,520	
Labour to install floorheat under old house + 20mm PEX 60m		F&G, EO	679	1	6,180	6,180	
Costs of Seasonal Thermal Energy Store							
Solar flexrohr twin ss insulated pipes	DN20 13mm insul 2x.75mm 25m +EPDM insul	Foamteam	1,181	50	215	10,750	
Tank 2: Steel tank in basement	23.6m3	Emils skrot Norköping April 2013	2,198	1	20,000	20,000	
Finned copper pipes & fittings tank 2		Rinkaby rör	1,138	1	10,358	10,358	
Foam insulation of tank 2	150mm	Ecofoam AB	2,754	1	25,063	25,063	
Copper pipes	from store	Sch Ltd	1,099	1	10,000	10,000	
New expansion vessels in attic	2x80lit expansion vessels ir	EO May 2013	1,538	1	14,000	14,000	
Upgrade to larger circulationpump EC type		LP July 2014	440	1	4,000	4,000	
Labour to install Solar flexrohr twin ss	Wilo Stratos 25/1-10 Can PI	Åke Häggman, Niklasson	1,152	1	10,480	10,480	
Connection to existing district heating		EO	2,198	1	20,000	20,000	
Repairs of leaks and new liquid	2013	EO	1,648	1	15,000	15,000	
Repairs leaks roof new with new teflon tape	changed part liquid	EO July 2015	879	1	8,000	8,000	
Sum:			53,878 €			490,287 SEK	

Fig 2. Capital Costs for STES installation

2.5 Treatment of the time value of money

The Life Cycle Cost and Savings analysis has been carried out with the following financial variables;

Annual Discount Rate $d = 3\%$ (based on the required IRR (Internal Rate of Return) within the company concerned at the time of the analysis).

Annual Rate of Inflation $i = 3\%$, reflecting the low average rates of inflation experience in Europe (Anon 2016a)

Annual Rate of Electricity Inflation $i_e = 7.3\%$ based on the average rate of electricity inflation over the period 1980 to 2016 (anon 2016b).

3.0 Results of financial analysis

3.1 Building 1

Fig. 3 gives a graphical representation of the NPV of the cost of the DHW and space heating for building 1 over the 40 year period, allowing the break point to be readily obtained.

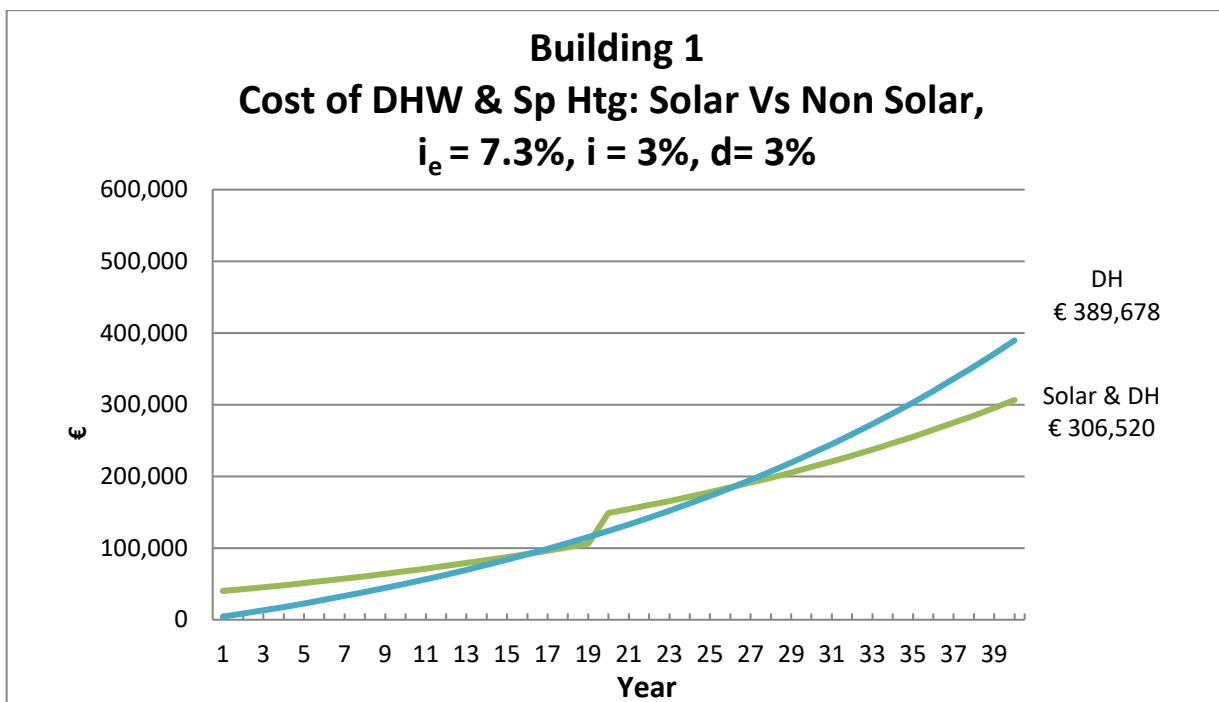


Fig. 3 NPV costs for heating building 1, comparing DH with solar

The overall NPV of the heating cost for building 1 using the DH system option is €389,678, with the cost using the solar installation (in combination with the DH) at €306,520. The base case (i.e. using only district heating) clearly is least expensive initially, as no extra expenditure is required. However over the 40 year period, the NPV of the base case is €83,158 (27.1%) higher compared with using the solar installation reflecting the higher DH annual running costs.

Breakeven occurs in year 16, after which the solar heating has a lower net present value than the base case. However, in year 20 the solar equipment has to be replaced. With the extra capital investment (reflecting a replacement of all equipment), breakeven does not occur again until year 26. From year 26, the solar installation has a lower NPV compared with the base case.

It is noted that in this Building 1 financial analysis, the extra cost associated with the STES is ignored given that no financial benefit will accrue in respect of heating building 1. It is assumed that while

the solar panels and combi system have been designed to provide heat to building 1 and 2, in the Building 1 analysis, the extra solar heat provided to building 2 has not been considered a benefit. Thus while the costs are reduced (due to the exclusion of the STES), similarly the benefits of the large solar array are also reduced. This is a necessary shortcoming of this financial analysis in respect of building 1.

3.2 Building 2

Fig. 4 gives the net present value for space heating and DHW for the combined load of building 1 and building 2, incorporating the cost and also the benefit of the seasonal thermal energy store. It shows that the overall NPV of the cost of heating building 1 and 2 using the DH system option (in combination with electric space heating) is €514,492, while the cost of using solar in combination with DH is €405,415. It is noted that the extra cost of heating building 1 and two compared with just heating building 1 with the solar option is only €98895 (32%), compared with €124,814 (again 32%) in the case of the DH option. While the DH base case is least expensive initially, the NPV of the base case is €109,077 (27%) higher than the NPV for using the solar installation, with breakeven occurring in year 17. This reflects the extra cost associated with the STES after which the solar installation has a lower NPV. Given the extra capital investment in year 20 (reflecting a replacement of all equipment), breakeven occurs again in year 27 after which the solar installation has a lower NPV.

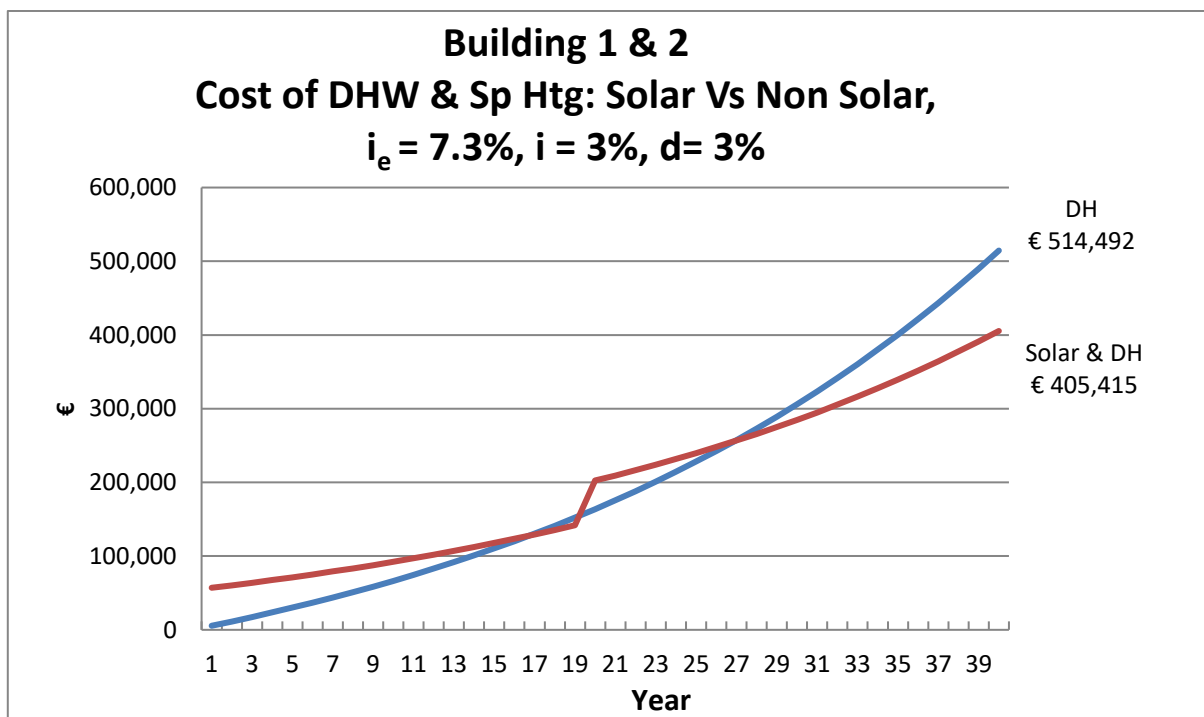


Fig. 4 NPV costs for heating building 1 and two, comparing DH with solar

Coincidentally the solar option provides a 27% saving for building 1 (ignoring the STES) and a 27% saving for building 1 and two (incorporating the STES).

4.0 Discussion and Conclusion

The costs of providing the required DHW and space heating for a multiunit development in Lysekil, Sweden are summarised. It is demonstrated that it is possible to provide significant solar

space heating cost effectively by integrating a STES and that there is an economic argument for the inclusion of an STES in the long term.

There are both advantages and disadvantages associated with using actual system costs and recorded performance figures for the installation in the analysis of the financial viability of a seasonal thermal energy store. The approach of grounding the analysis in a real installation provides the benefit of providing real figures in the analysis, rather than figures based on theoretical system modelling. However, the actual installation could be optimised further which would result in a more favourable financial viability. Also, it is noted is that while fig. 3 gives the costs associated with heating building one only, and excludes the STES, the STES is required from a technical perspective to avoid thermal stratification by providing a heat load for the 50 m² of solar panels. Because the excess heat can be accommodated by the STES, the solar fraction achieved in building one is increased beyond what would be possible without the STES.

In addition, the financial variables used are specific to the peculiarities of the site. A number of specifics are of note. The use of a second-hand Stes tank significantly increases the financial viability of the installation. In addition, the relatively high long-term Swedish electricity inflation rate of over 7% also contributes to the viability of the STES, although it should be noted that in recent years the wholesale electricity rate in Sweden has declined. Also of note is the fact that the district heating available at the site provides a low-cost means of heating and thus would mitigate against installing anything other than a basic system.

Overall, the specific STES is seen to be financially viable. Further scenarios should be considered as part of a separate paper to examine the impact of the variables for other multiunit STES implementations.

5.0 Acknowledgements

This study has received funding from European Union's Horizon 2020 research and innovation programme under grant agreement N° 657466 (INPATH-TES).

6.0 References

- Anon, 2013a Energy Performance of Buildings Directive 2010/31/EU (EPBD) (recast). Available: <http://eurex.europa.eu/LexUriServ/LexUriServ.do?uri=OJ:L:2010:153:0013:0035:en:PDF> (Last accessed Dec 2016).
- Anon 2013b-last update, What is a Passive House? Available: https://passipedia.org/basics/the_passive_house_-_definition (Last accessed Dec 2016).
- Anon 2016a, Annual Average Rates of Inflation. Available: EUROSTAT, Annual Average Rates of Inflation, http://ec.europa.eu/eurostat/statistics-explained/index.php/Inflation_in_the_euro_area.
- Anon 2016b, Sweden inflation rate, 1980 to 2016, available from <http://www.tradingeconomics.com/sweden/inflation-cpi> (last accessed December 2016)
- BADESCU, V. and STAICOVICE, M.D., 2006. Renewable energy for passive house heating. Model of the active solar heating system. *Energy and Buildings*, **38**, pp. 129--141.
- BADESCU, V., LAASER, N., CRUTESCU, R., CRUTESCU, M., DOBROVICESCU, A. and TSATSARONIS, G., 2011. Modeling, validation and time-dependent simulation of the first large passive building in Romania. *Renewable Energy*, **36**(1), pp. 142-157.
- CLARKE, J., COLCLOUGH, S., GRIFFITHS, P. and MCLESKEY, J.T., 2013. A passive house with seasonal solar energy store: in situ data and numerical modelling. *International Journal of Ambient Energy*, , pp. 1-14.

- COLCLOUGH, S.M., 2011. *Thermal energy storage applied to the Passivhaus standard in the Irish climate*, University of Ulster.
- COLCLOUGH, S. and GRIFFITHS, P., 2016. Financial analysis of an installed small scale seasonal thermal energy store. *Renewable Energy*, **86**, pp. 422-428.
- DINCER, I. and ROSEN, M., 2002. *Thermal Energy Storage. Systems and Applications*. Chichester, England: Wiley.
- GRIFFITHS P and COLCLOUGH S, 5 June 2015. Seasonal Thermal Storage Handbook of Clean Energy Systems Hardcover – Jinyue Yan (Author). pp. 2479-2496.
- GUERRA-SANTIN, O., TWEED, C., JENKINS, H. and JIANG, S., Monitoring the performance of low energy dwellings: two UK case studies. *Energy and Buildings*, **Volume 64**(September 2013), pp. Pages 32–40.
- HADRON, J., ed, 2005. *Thermal Energy Storage for Solar and Low-Energy Buildings. State-of-the-art*. International Energy Agency Solar Heating and Cooling Programme.
- HUGO, A., ZMEUREANU, R. and RIVARD, H., 2010. Solar combisystem with seasonal thermal storage. *Journal of Building Performance Simulation*, **3**(4), pp. 255-268.
- LECKNER, M. and ZMEUREANU, R., 2011. Life cycle cost and energy analysis of a Net Zero Energy House with solar combisystem. *Applied Energy*, **88**(1), pp. 232-241.
- RIDLEY, I., CLARKE, A., BERE, J., ALTAMIRANO, H., LEWIS, S., DURDEV, M. and FARR, A., 2013. The monitored performance of the first new London dwelling certified to the Passive House standard. *Energy and Buildings*, **63**(0), pp. 67-78.
- SCHNIEDERS, J. and HERMELINK, A., 2006. CEPHEUS results: measurements and occupants' satisfaction provide evidence for Passive Houses being an option for sustainable building. *Energy Policy*, **34**(2), pp. 151-171.