



## NUMERICAL SIMULATION OF FIRE SPREADING IN A TWO-STOREY RESIDENTIAL BUILDING

Kolaitis, D., Asimakopoulou, E., & Founti, M. (2010). *NUMERICAL SIMULATION OF FIRE SPREADING IN A TWO-STOREY RESIDENTIAL BUILDING*. Paper presented at INTERFLAM 2010, 12th International Conference On Fire Science And Engineering.

[Link to publication record in Ulster University Research Portal](#)

### Publication Status:

Published (in print/issue): 01/01/2010

### Document Version

Author Accepted version

### Document Licence:

Unspecified

### General rights

The copyright and moral rights to the output are retained by the output author(s), unless otherwise stated by the document licence.

Unless otherwise stated, users are permitted to download a copy of the output for personal study or non-commercial research and are permitted to freely distribute the URL of the output. They are not permitted to alter, reproduce, distribute or make any commercial use of the output without obtaining the permission of the author(s).

If the document is licenced under Creative Commons, the rights of users of the documents can be found at <https://creativecommons.org/share-your-work/ccllicenses/>.

### Take down policy

The Research Portal is Ulster University's institutional repository that provides access to Ulster's research outputs. Every effort has been made to ensure that content in the Research Portal does not infringe any person's rights, or applicable UK laws. If you discover content in the Research Portal that you believe breaches copyright or violates any law, please contact [pure-support@ulster.ac.uk](mailto:pure-support@ulster.ac.uk)

# NUMERICAL SIMULATION OF FIRE SPREADING IN A TWO-STOREY RESIDENTIAL BUILDING

Dionysios I. Kolaitis\*, Eleni Asimakopoulou, Maria A. Founti

Laboratory of Heterogeneous Mixtures and Combustion Systems, Thermal Engineering Section,  
School of Mechanical Engineering, National Technical University of Athens, Greece.

\*e-mail: [dkol@central.ntua.gr](mailto:dkol@central.ntua.gr)

## ABSTRACT

A CFD tool is used to simulate a full-scale two-storey residential building subjected to a typical domestic fire. The detailed numerical simulation of the occurring physical and chemical phenomena allows the investigation of the developing flow-field, the fire spreading characteristics, as well as the thermal behaviour of the construction materials. The FDS code is used to simulate the turbulent, multi-component and reactive flow-field developing inside the building. The examined building is constructed using a structural steel frame configuration with dry-wall systems. The internal and external walls consist of various layers of gypsumboard, cementboard and insulating materials. When a gypsumboard is subjected to a high temperature environment, water molecules bound in its crystal lattice are released and transferred through the board, absorbing energy and thus reducing the mean wall temperature; this process is known to enhance the fire resistance characteristics of the structure. The actual thermo-physical properties of all the construction and furniture house materials are taken into account, in order to accurately describe their thermal behaviour. The simulated 152 m<sup>2</sup> two-storey building is considered to be completely furnished according to a standard residential configuration. The fire resistance behaviour of the building is evaluated by considering three realistic alternative ventilation scenarios. Numerical predictions of the temporal evolution of various parameters such as gas velocity, gas and wall temperatures, toxic gas concentrations and smoke movement are obtained for the entire domain that represents the interior of the building. Gas velocity and temperature predictions are used to visualize the developing flow-field and to estimate the heat flux that each building element is exposed to. Predicted wall temperatures allow the assessment of the steel frame – dry-wall construction technique in terms of fire resistance.

## 1. INTRODUCTION

Fire is one of the most complex phenomena considered in combustion science, since it embraces nearly all the effects found in subsonic chemically reacting flows. Fluid dynamics, combustion, chemical kinetics, radiation and multi-phase flow effects are linked together to provide an extremely complex physical and chemical phenomenon. It is this complexity that delayed the development of fire research as a science until the 1950s. Fires are associated with a large range of hazards to humans, property and the environment. Amongst the variety of incidents of uncontrollable fires, unwanted fires in enclosures are the most frequently encountered<sup>1</sup>. In building fires, the confined space controls the air supply and thermal environment of the fire, which affect the spread, growth, maximum burning rate and duration of the fire. Fire safety regulations have a major impact on the overall design of buildings with regard to layout, aesthetics, function and cost.

According to National Fire Protection Association, there were 1,451,500 fires in the United States in the year 2008<sup>2</sup>. 84% of all fire fatalities occurred in homes, i.e. one- and two-family dwellings and apartments. The most important areas of origin in residential fires are the kitchen (34%), the bedroom (12%) and the living room (6%)<sup>3</sup>. Fires that start by lighted tobacco products occur mainly either in the bedroom or in the living room and constitute the leading cause of residential fire deaths<sup>4</sup>. Cooking fires are often the result of the ignition of loose clothing or other nearby flammable materials from unattended cooking where grease or oil ignites. In 2003, there were 118,700 reported cooking-related home structure fires in the U.S.A., which resulted in 250 fatalities, 3880 injuries and \$512 million in direct property

damage<sup>5</sup>.


In recent years, a variety of numerical tools have been developed to enable the prediction of fire growth within enclosures. Computational Fluid Dynamics (CFD) tools allow the numerical solution of the fundamental equations describing the transfer of mass, momentum and energy in an enclosure fire environment. These tools have been successfully used in a variety of fire safety areas, such as fire protection engineering (e.g. prediction and visualization of fire and smoke movement), building architectural design (prediction of fire behaviour to estimate the optimal place for fire exits or sprinkler placement and operation), fire safety strategy for a building (e.g. prediction of smoke flow patterns to estimate the optimal design of smoke control systems), accident investigation, building re-design etc. The role of CFD tools in fire research is steadily increasing as the models become progressively robust and sophisticated and validation studies make them more reliable. The CFD approach is considered to be fundamental to the future development of fire models, which can provide the basis for performance-based fire safety regulations.

In this context, the use of CFD tools is necessary to extend beyond simplified geometrical configurations in order to ascertain their applicability in real building fires<sup>1</sup>. However, most of the available studies focus mainly in single-room or two-room simulations<sup>6,7</sup>. Scarce reports are available in the open literature regarding multi-room compartment fire simulations; they mainly focus on the investigation of accidental fires<sup>8</sup>. A round-robin study performed recently has revealed the difficulties associated with modelling fire dynamics in complex fire scenarios using CFD tools, suggesting that the respective accuracy of fire growth predictions is still generally poor<sup>9</sup>. The main scope of the present study is to investigate the ability of currently available CFD tools to effectively simulate the flow- and thermal-fields developing in a full-scale two-storey residential house during a fire accounting for detailed material properties.

## 2. DESCRIPTION OF THE BUILDING

The modelled two-storey, 152 m<sup>2</sup>, residential house represents a typical Greek family two-storey dwelling (Figure 1), with a typical residential arrangement plan (ground floor: kitchen, office and living room, first floor: master and auxiliary bedroom). The house is constructed using a load-bearing steel frame combined with dry wall system (multi layered plasterboard assemblies), in accordance with earthquake, fire-resistance, thermal and sound insulation requirements. The external walls of the house are multi-layered, consisting of (from the interior to the exterior) two 12.5 mm plasterboards, a 182.5 mm void (allowing space for the steel frame and plumbing), a 12.5mm plasterboard, a layer of 80 mm rockwool, a 12.5 mm cementboard and a final layer of 50 mm EPS polystyrene. The internal walls consist of two 12.5 mm plasterboards, a layer of 80 mm rockwool and two 12.5 mm plasterboards.

**Figure 1.** Photorealistic view of the building (left) and interior of the ground floor (right).

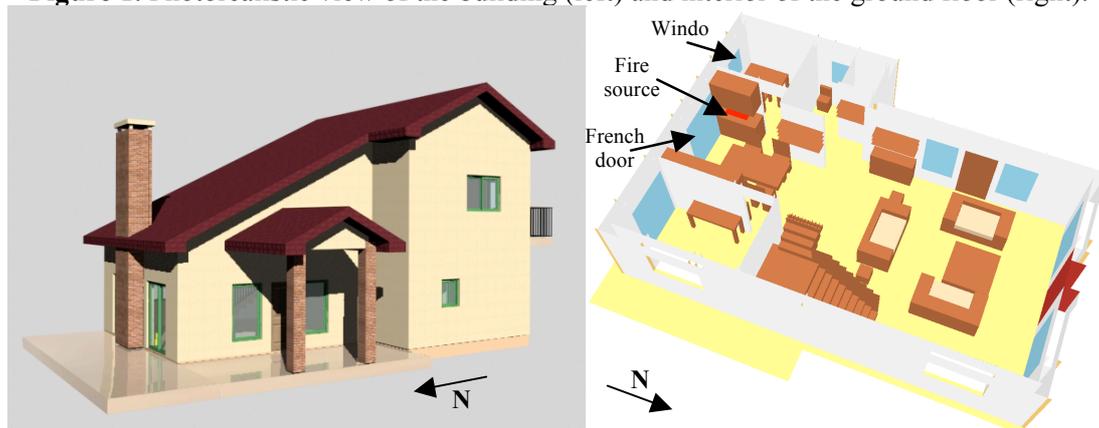

Gypsum plasterboards are widely used in the building industry for a variety of applications as an aesthetically pleasing, easily applied and mechanically enduring facing material for walls and ceilings. In the context of building fire safety, gypsum plasterboards are capable of decelerating the penetration of fire through walls and floors, due to the endothermic gypsum dehydration process occurring in high temperatures. When a plasterboard is subjected to a high temperature environment, water molecules

bound in its crystal lattice are released and transferred through the board, absorbing energy and thus reducing the mean wall temperature. This process is known to improve the global fire resistance of the building and it is suggested to enhance the safety margins of the building, by allowing longer evacuation times<sup>10</sup>.

The thermo-physical properties of the construction and furniture materials used in the house were obtained from the open literature<sup>11-13</sup>. The physical properties of gypsum are varying with increasing temperatures, due to the occurring chemical reactions (dehydration). The utilization of temperature-dependent physical properties is known to yield more accurate results in heat transfer simulations of gypsum plasterboards, compared to mean values<sup>14</sup>. Therefore, temperature-dependent values for thermal conductivity (measured using the hot wire method) and specific heat<sup>15</sup> were used in the simulations.

### 3. NUMERICAL SIMULATION

The Fire Dynamics Simulator (FDS) code is a CFD tool capable of studying fundamental fire dynamics and combustion, aimed at solving practical fire problems in fire protection engineering<sup>16</sup>. The FDS code solves numerically a form of the Navier-Stokes equations appropriate for low-speed, thermally driven flows, with an emphasis on smoke production and heat transfer from fires. The core algorithm is an explicit predictor-corrector scheme that is second order accurate in space and time. Turbulence is treated by using the Large Eddy Simulation (LES) approach. The subgrid-scale turbulence is simulated using the Smagorinsky model, utilizing a Smagorinsky constant value of 0.2. The numerical time-step is continuously adjusted in order to satisfy the CFL criterion. The partial derivatives of the conservation equations of mass, momentum and energy are approximated as finite differences and the solution is updated in time on a three-dimensional, Cartesian grid. Thermal radiation is simulated using the finite volume methodology on the same grid as the flow solver. All solid surfaces are assigned thermal boundary conditions by taking into account information about the burning behaviour of the respective material.

The considered house is enclosed within a rectangular volume, measuring 12.8 m, 11.2 m and 8 m, in the x-, y- and z- directions respectively. The numerical grid used divided this volume into 798,720 cubic computational cells, each having a side of 0.1 m. Certain construction and decorative details were “roughly” approximated in order to limit the size of the computational grid required for the simulations. However, the house was considered to be completely furnished, following a standard residential configuration. At the beginning of the numerical simulation ( $t = 0$  s), the entire computational domain (both indoors and outdoors) is assumed to be still (zero velocity), exhibiting a temperature of 20°C. The total simulation time was 15 min, in order to be able to capture with sufficient detail the most important characteristic stages of the developing fire, namely initiation, spreading and decay. The total CPU-time needed for the complete simulation was approximately 24 hours on a 4 GB, Quad Core 2.4 GHz desktop PC, using the “parallel computation” version of the FDS code.

The selection of the proper physical properties and pyrolysis rate coefficients for the combustible materials is a very challenging task; especially for the latter, values derived from small and large-scale experiments may exhibit differences of several orders of magnitude<sup>17</sup>. The simulated house was assumed to be equipped mainly with wooden furniture. A single step Arrhenius reaction was used to model the thermal decomposition of wood; the kinetic and thermal parameters used in the simulations were found in the literature<sup>12</sup>. The combustible gases produced by wood pyrolysis were considered to be described by the collective chemical species  $C_{3.4}H_{6.2}O_{2.5}$ <sup>18</sup>; a mixture fraction model was used to simulate combustion.

Cooking equipment is the primary cause of reported home fires and home fire injuries in the U.S.A.<sup>4</sup>. In this study, the ignition source was assumed to be a typical cooking fire represented by a 0.8 m by 0.2 m rectangular “patch” located on the upper surface of the birch wood kitchen bench (Figure 1). A constant 300 kW fire was assumed to appear at  $t=0$ s; the fire power was selected according to relative suggestions in the literature regarding fires related to kitchen equipment and cooking vegetable oil<sup>19</sup>.

The computational domain extended approximately 2.0 m outwards from each side of the house;

therefore, airflow in the surrounding environment could be also simulated, thus allowing studying of the effects of open external doors or windows. Three different scenarios have been developed in order to investigate the effect of ventilation in the fire-spreading rate. In the first (Test Case 1), which served as a basis for comparison, all external house openings (doors and windows) were considered closed, whereas all the internal openings were considered to be fully open. As a result, no gas flow was allowed to occur from the inside of the house to the surrounding environment and vice versa. However, there was still some form of interaction between the indoor and outdoor fields, since heat conduction was calculated through the external walls of the house. In the 2<sup>nd</sup> Test Case, the southern French door (1.6 m x 2.2 m), located very close to the fire source, was considered to be fully open, thus providing large amounts of fresh air into the main combusting zone (c.f. Figure 1). Finally, Test Case 3 corresponded to an open window (0.8 m x 1.0 m), which is located in a room adjacent to the kitchen. The performed parametric study aimed to investigate the impact of alternative ventilation schemes, which are known to have a significant effect on the characteristics of fire development (under-ventilated, well-ventilated fires).


#### 4. RESULTS AND DISCUSSION

**Figure 2.** Predictions of velocity vectors 9 min after the fire initiation.



A characteristic image of the developing flow-field is presented in Figure 2, which depicts predictions of the instantaneous gas phase w-velocity vectors over a vertical plane, 9 min after the initiation of the fire for the three investigated scenarios. In all cases, the largest velocity values are observed near the fire region, where the thermally induced buoyancy phenomena are very strong due to the large temperature gradients. A typical stratified fire-induced flow field is developed in the house; the large density variation forces the mixture of air and combustion products to rise, leading to the consequent entrainment of the cold ambient air to the lower part of the house. The strong buoyant upward flow from the kitchen room door to the ceiling of the living room is clearly visible. Compared to Test Case 1 (Figure 2, left), the entrainment of fresh air from the surrounding environment, either through the French door in Test Case 2 (Figure 2, middle) or through the nearby window in Test Case 3 (Figure 2, right), renders the developing flow-field more intense, exhibiting higher velocities.

**Figure 3.** Predictions of gas mixture temperature 9 min after the fire initiation.

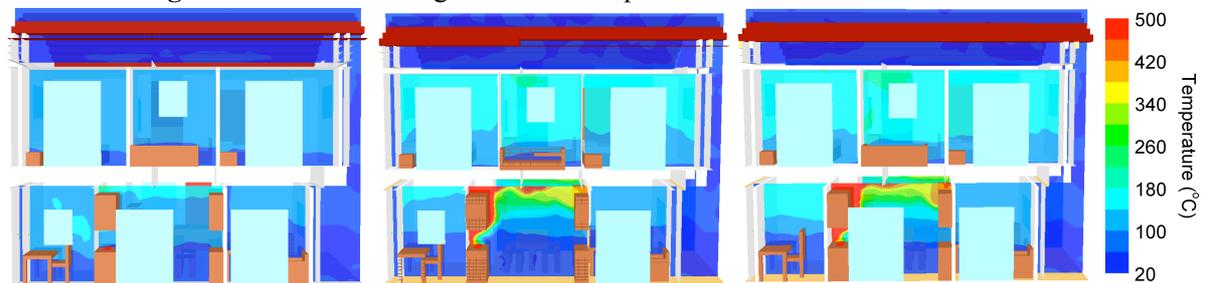


Predictions of the gas temperature temporal evolution over a vertical plane are depicted in Figure 3. As expected, the highest temperatures are observed in the region just above the fire source, where the main fire plume is established. Due to the large indoor openings that do not impede flow circulation and the large volume of the entire house, which serves as a “thermal fly-wheel” not allowing the local temperatures to rise significantly, “conventional” flashover is not observed. The stratification of the developing flow-field leads to the formation of a similarly stratified thermal field. Fresh air entrainment through the French door (Test Case 2) and the window (Test Case 3) is evident in the lower part of the

kitchen room (Figure 3, middle) and the nearby room (Figure 3, right), respectively. A similar thermal stratification, although less distinct, also develops in the upper floor, where relatively high temperatures are observed in the well-ventilated fire scenarios (Test Cases 2 and 3).

CFD simulations allow the estimation of fire resistance of entire buildings. In this context, the mechanical strength of gypsum plasterboard wall assemblies is investigated. It should be noted here that plasterboard walls are not load bearing, therefore their failure cannot contribute in case of partial collapse of the building. Gypsum plasterboards exposed to fire are considered to exhibit mechanical failure when cracks or openings are observed through the wall<sup>20</sup>; however, since cracking phenomena cannot be accurately simulated in the CFD code, alternative failure criteria had to be used. According to the Australian Standard AS1530.4, a plasterboard wall fails when the maximum temperature rise (above the ambient temperature) of the ambient facing side exceeds 180°C<sup>21</sup>.

Surface temperature predictions for the interior assembly of the external kitchen wall, which lies closer to the fire source, are depicted in Figure 4 (left). It is evident that the unexposed side of the wall assembly (which consists of a double layer of plasterboard) exhibits a very modest temperature rise. However, the side which is directly exposed to the fire source reaches high temperature levels, exceeding the “limiting” temperature of 180°C quite early in the simulation. The gradual decrease of the wall temperature observed in Test Case 1 suggests that the lack of fresh air entrainment results in the fire becoming under-ventilated.

**Figure 4.** Temporal evolution of the surface temperature of the interior assembly of the external kitchen wall (left) and the gas temperature in the middle of the kitchen, at a height of 2.4 m (right).

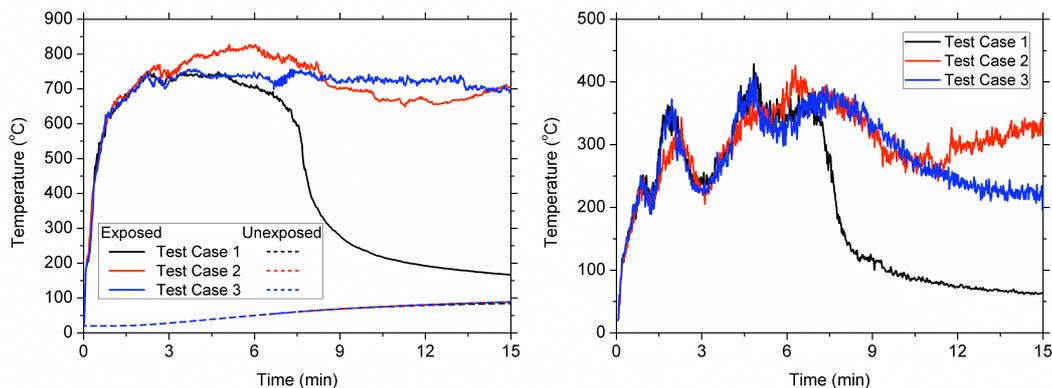

In order to evaluate life safety in fire conditions using a numerical modelling tool, quantitative tenability criteria are needed. An average person exposed for more than a few minutes to high levels of temperature and heat flux, is likely to suffer burns and die, either during or immediately after exposure, mainly due to hyperthermia. According to the S.F.P.E. Handbook<sup>13</sup>, the reported tolerance times for air temperature of 126°C is 7 min, whereas for 180°C is 4 min. Temperature predictions in the kitchen room (Figure 4, right) suggest that this region quickly becomes untenable in all the considered test cases. The limiting effects of oxygen deprivation on the fire evolution in Test Case 1 are again evident (under-ventilated fire conditions).

## 5. CONCLUSIONS

A CFD tool has been used to simulate the thermal flow-field developing in a full-scale two-storey residential building during a fire. The considered building was constructed using a load-bearing steel frame combined with dry wall systems. Detailed physical properties have been used to describe the thermal behaviour of the various building materials; the effects of gypsum dehydration were taken into account by utilizing temperature-dependent properties for the gypsum plasterboards. Gas velocity and temperature predictions have been used to visualize the developing flow-field. Predicted wall temperatures allowed the assessment of the fire resistance behaviour of the investigated building. Finally, gas temperature predictions allowed risk assessment for the tenants of the building. The ability of

currently available CFD tools to effectively simulate fire spreading in realistic residential fire scenarios has been demonstrated. However, due to the complexity of the occurring physico-chemical phenomena, further validation studies are needed to assess the quantitative accuracy of the obtained predictions.

## ACKNOWLEDGMENTS

The present study has been financially supported by the E.C. in the frame of the FP6 project I-SSB: The Integrated Safe and Smart Built Concept (NMP2-CT-2006-026661).

## REFERENCES

- <sup>1</sup> Yeoh, G.H. and Yuen, K.K. (2009) *Computational Fluid Dynamics in Fire Engineering*, Elsevier.
- <sup>2</sup> Karter, M. J., (2009) "Fire losses in the United States during 2008" NFPA Report No FLX08
- <sup>3</sup> Madrzykowski, D. and Hamins, A., (2007) Residential kitchen fire suppression research needs: Workshop Proceedings, NIST Special Publication 1066, Washington, U.S.A.
- <sup>4</sup> Ahrens, M., Hall, J., Comoletti, J., Gamache, S. and LeBeau, A., (2004) A profile of fire in the United States 1992-2001 U.S. Fire Administration Report, 13<sup>th</sup> Edition, MD, U.S.A.
- <sup>5</sup> Hall, J. R., (2006) "Home-cooking fire patterns and trends" NFPA Report, U.S.A.
- <sup>6</sup> Hasib, R., Kumar, R., Shashi and Kumar, S., (2007) "Simulation of an experimental compartment fire by CFD", *Building and Environment* 42, p3149-p3160.
- <sup>7</sup> Merci, B. and Maele, K. V., (2008) "Numerical simulations of full-scale enclosure fires in a small compartment with natural roof ventilation", *Fire Safety Journal* 43, p495-p511.
- <sup>8</sup> Rein, G., Bar-Ilan, A. and Fernandez-Pello, C., (2006) "A Comparison of three Models for the Simulation of Accidental Fires", *Journal of Fire Protection Engineering* 16, p183-p209.
- <sup>9</sup> Rein, G., Torero, L. J., Jahn, W., Stern-Gottfried, J., Ryder, L. N., Desanghere, S., Lazaro, M., Mowrer, F., Coles, A., Joyeux, D., Alvear, D., Capote, A. J., Jowrsey, A., Abecassis-Empis, C. and Reszka, P., (2009) "Round-robin study of a priori modelling predictions of the Dalmarnock Fire Test One" *Fire Safety Journal* 44, p590-p602.
- <sup>10</sup> Wang, C.Y. and Ang, C.N., (2004) "The effect of water movement on specific heat of gypsum plasterboard in heat transfer analysis under natural fire exposure" *Constr. Build. Mater.* 18, p505-p515.
- <sup>11</sup> Prasad, K., Kramer, R., Marsh, N. and Nyden, M., (2009) "Numerical simulation of fire spread on polyurethane foam slabs", *Proceedings of the 11<sup>th</sup> International Conference of Fire and Materials 2009*, 26-28 January 2009, San Francisco, U.S.A.
- <sup>12</sup> Matala, A., (2008) Estimation of solid phase reaction parameters for fire simulation, M.Sc. Thesis, Faculty of Information and Natural Sciences, Helsinki University of Technology.
- <sup>13</sup> DiNenno, P. J., Drysdale, D., Beyler, C. L., Walton, W. D., Cruster, R. L. P., Hall, J. R. and Watts, J. M., (2002) *SFPE Handbook for Fire Engineering*, 3<sup>rd</sup> Edition, N.F.P.A., U.S.A.
- <sup>14</sup> Kontogeorgos, D. A., Kolaitis, D. I. and Founti M, A., "Numerical Modelling of Heat Transfer in Gypsum Plasterboards Exposed to Fire", *Proceedings of the 6<sup>th</sup> International Conference on Heat Transfer, Fluid Mechanics and Thermodynamics*, 30 June-2 July 2008, Pretoria, South Africa.
- <sup>15</sup> Wakili, K. G., Hugi, E., Wullschlegler and Frank, T. H., (2007) "Gypsum board in fire – modelling and experimental validation" *Journal of Fire Sciences* 25, p267-p184.
- <sup>16</sup> McGrattan, K. B., McDermott, R., Hostikka, S. and Floyd, J. (2010) "Fire Dynamics Simulator (Version 5) User's Guide"
- <sup>17</sup> Hostikka, S. and McGrattan, K. B., (2001) "Large eddy simulation of wood combustion", *Proceedings of the 9<sup>th</sup> International Interflam Conference*, 17-19 September 2001, Edinburgh, U.K.
- <sup>18</sup> Ritchie, J. S., Steckler, D. K., Hamins, A., Cleary, G. T., Yang, C. J. and Kashiwagi, T., (1997) "The effect of sample size on the heat release rates of charring materials" *Proceedings of the 5<sup>th</sup> International Symposium on Fire Safety Sciences*, 3-7 March 1997, Melbourne, Australia.
- <sup>19</sup> Luo, M. and Beck, V., (1994) "The fire environment in a multi-room building-comparison of predicted and experimental results" *Fire Safety Journal* 23, p413-p438.
- <sup>20</sup> Manzello, L. S., Gann, G. R., Kukuck, R. S. and Lenhart, B. D., (2007) "Influence of gypsum board type on real fire performance of partition assemblies" *Fire and Materials* 31, p425-p442.

<sup>21</sup>Clancy, P., (2002) "A parametric study on the time-to-failure of wood framed walls in fire" Fire Technology 38, p243-p269.