



Modelling Different PV-Based Minigrids Architectures

Opiyo, N. (2018). *Modelling Different PV-Based Minigrids Architectures*. Poster session presented at 35th European Photovoltaic Solar Energy Conference, Brussels, Belgium.

[Link to publication record in Ulster University Research Portal](#)

Publication Status:

Published (in print/issue): 24/09/2018

Document Version

Publisher's PDF, also known as Version of record

General rights

The copyright and moral rights to the output are retained by the output author(s), unless otherwise stated by the document licence.

Unless otherwise stated, users are permitted to download a copy of the output for personal study or non-commercial research and are permitted to freely distribute the URL of the output. They are not permitted to alter, reproduce, distribute or make any commercial use of the output without obtaining the permission of the author(s).

If the document is licenced under Creative Commons, the rights of users of the documents can be found at <https://creativecommons.org/share-your-work/ccllicenses/>.

Take down policy

The Research Portal is Ulster University's institutional repository that provides access to Ulster's research outputs. Every effort has been made to ensure that content in the Research Portal does not infringe any person's rights, or applicable UK laws. If you discover content in the Research Portal that you believe breaches copyright or violates any law, please contact pure-support@ulster.ac.uk

Modelling Different PV-Based Minigrids Architectures




UNIVERSITY OF LEEDS

Nicholas N. Opiyo

elno@leeds.ac.uk

Introduction:

A PV-based communal grid is defined as a locally confined and independently controlled electric power grid in which a distribution architecture integrates distributed loads and distributed energy resources

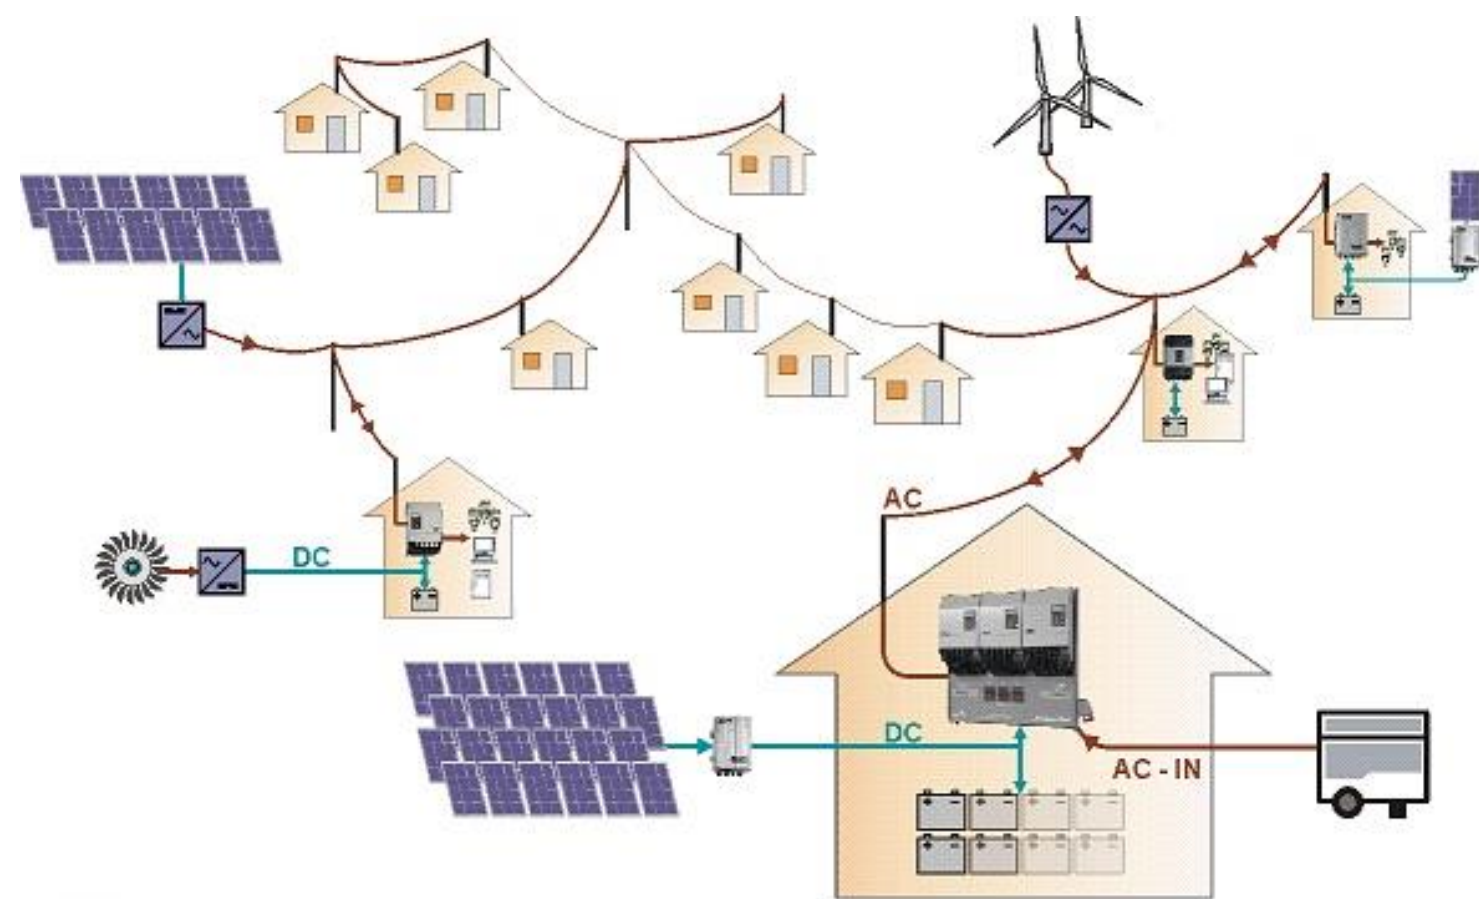

Village Power - Mini Grid

Fig. 1: A PV-Based Hybrid Minigrid

Inverters used to interface communal grids with utility grids can be classified according to modes of operation as PQ or V-f, and modelled as [1-3]

$$P(f) = P_0 - (f_{set} - f)k_f$$

$$Q(V) = Q_0 - (V_{set} - V)k_v$$

Methodology:

Different communal grid architectures, revolving about energy storage, are modelled and simulated in MATLAB/Simulink to determine the most cost-effective option for a given transmission and distribution network.

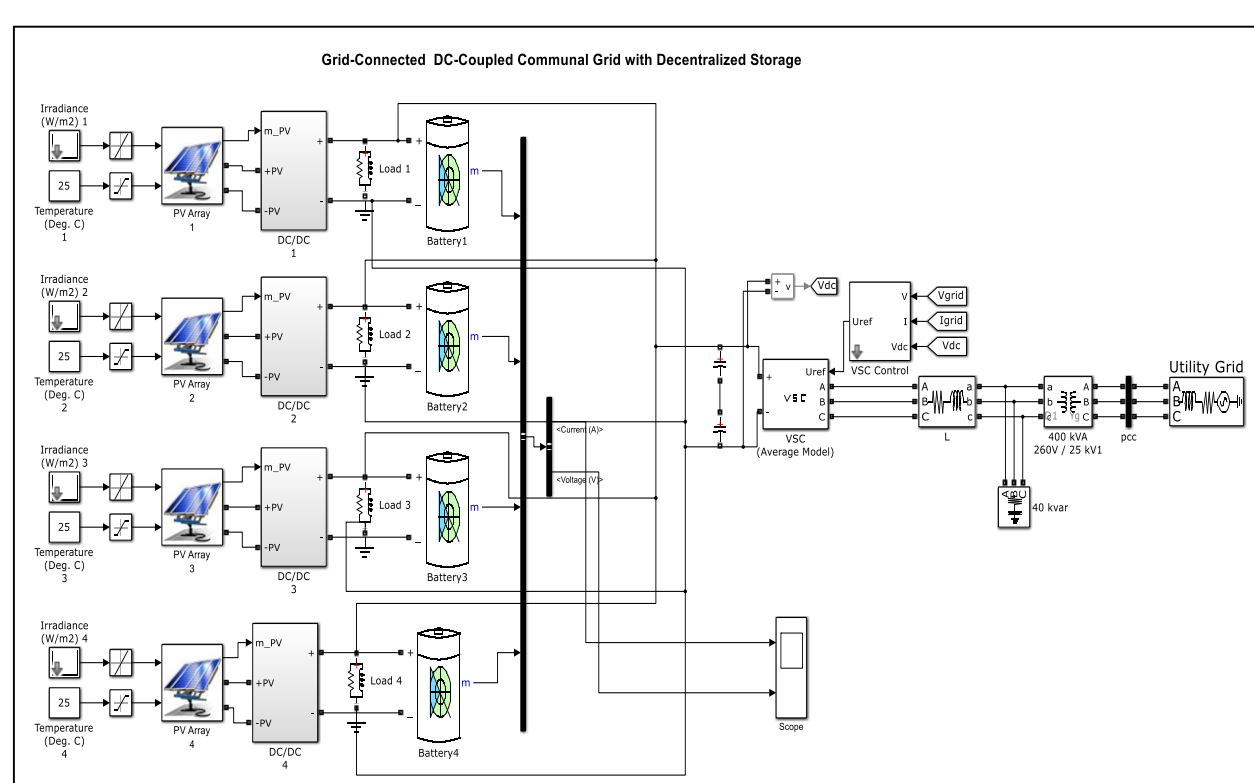


Fig. 2: Simulink Model of a DC-Coupled Minigrid

Simulated data from the Simulink models are fed into an agent based model (ABM) developed in NetLogo, to simulate effects of control architectures on temporal diffusion of PV-based communal grids in a rural developing community

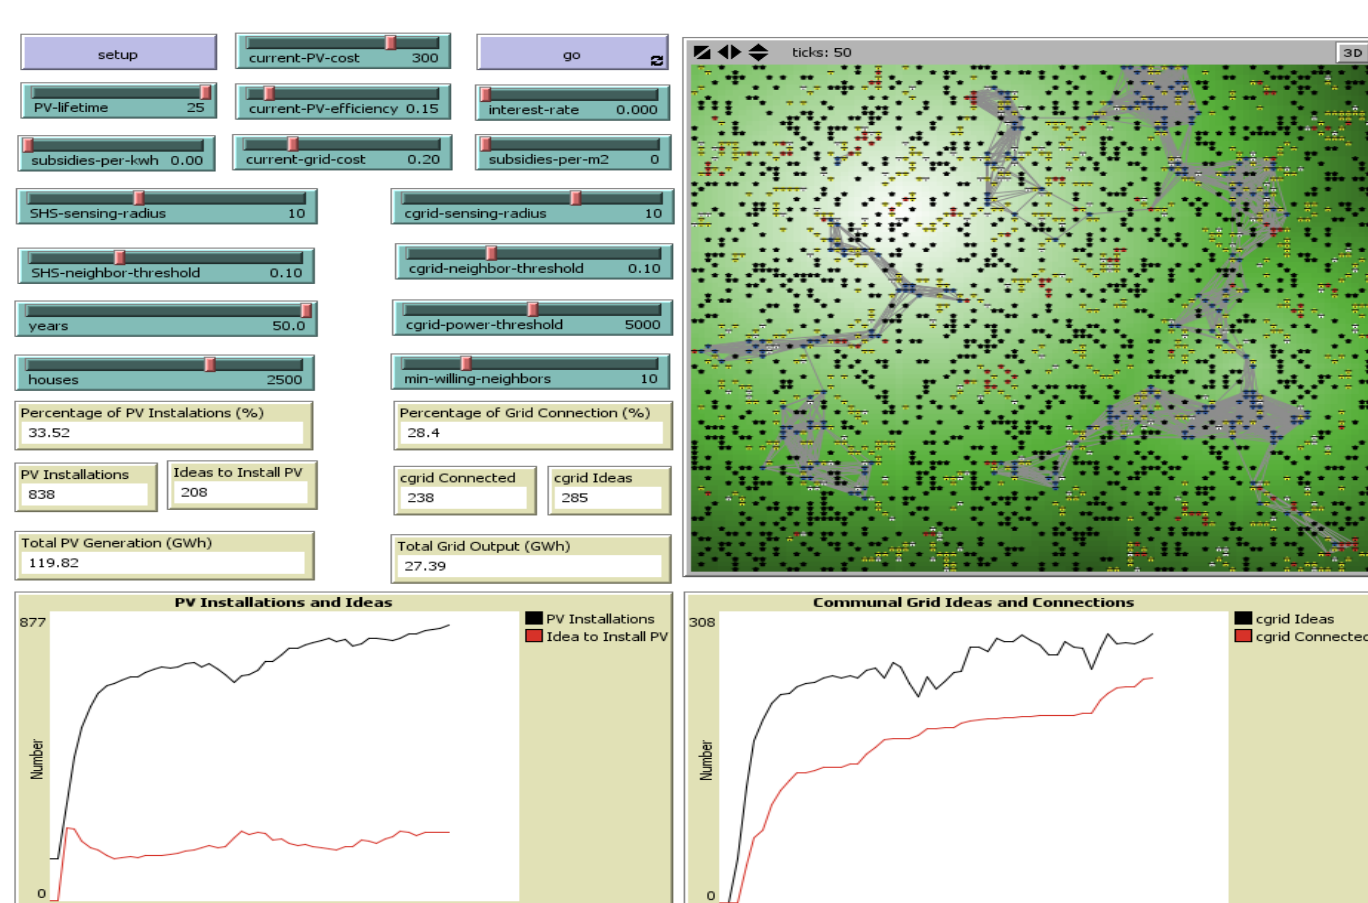


Fig. 3: NetLogo Graphical User Interface

Results and Discussion:

After 25 years, 2,103 households would have joined communal grids with decentralised storage systems, representing 21.5% of all households. This is higher than the 1,571 households that would have joined networks with centralised storage systems, representing 16% of all households.

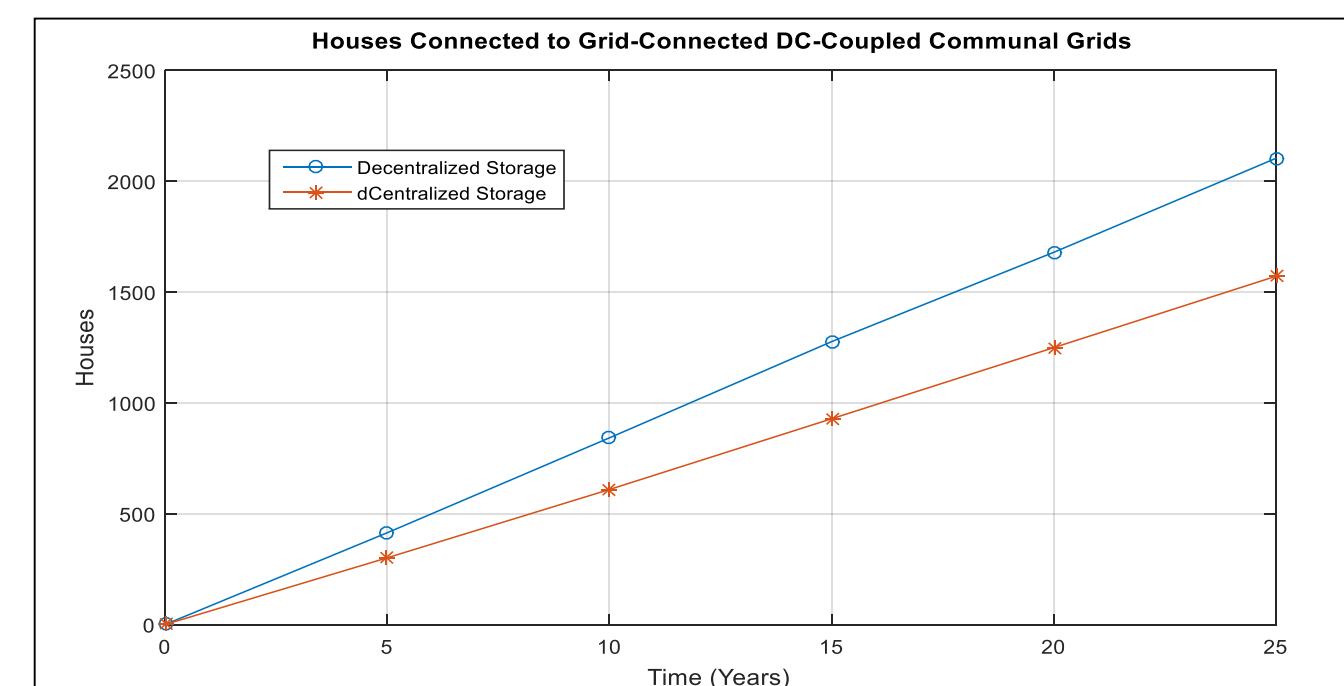


Fig. 4: Houses Connected to DC-Coupled Networks

After 25 years, 1,887 households would have joined communal grids with decentralised storage systems, representing 19.2% of all households. This is higher than the 1,286 households that would have joined networks with centralised storage systems, representing 13.1% of all households

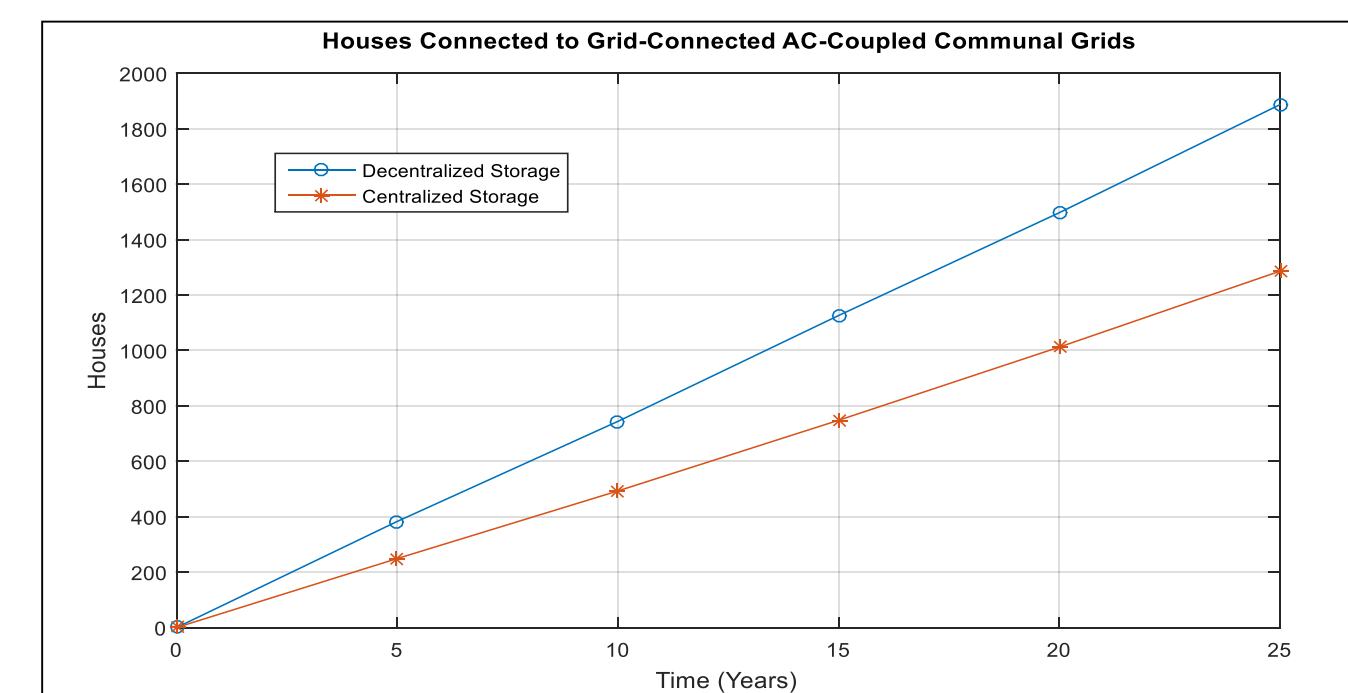


Fig. 5: Houses Connected to AC-Coupled Networks

Conclusion:

Generally, DC-coupled networks seem to fair better than AC-coupled networks in all categories. This is mainly due to cost and ease of set-up of such networks; DC systems are more modular and scalable than AC systems because DC converters are easier to control and to parallel. This allows for more flexibility in system design and expansion, and thus more effective capital investment management. Table 1 summarises the above information.

Table 1: Comparison of Houses Connected to DC- and AC-Coupled Networks

Time (Years)	DC-Coupled		AC-Coupled	
	Decentralised Storage	Centralised Storage	Decentralised Storage	Centralised Storage
0	0	0	0	0
5	414	301	383	249
10	842	609	744	493
15	1276	928	1126	748
20	1679	1249	1497	1012
25	2103	1571	1887	1286

In conclusion, for cost-effective communal grids, DC-coupled networks with decentralised storage systems are recommended as the most-cost effective architectures for rural communal grids. Where a communal grid must be AC-coupled communal grids, systems with decentralised storage and multi-master operation modes are recommended for cost-effectiveness

Acknowledgement: This research was funded by Leeds International Research Scholarship