

1 Article

2 Energy Storage on A Distribution Network for 3 Self-Consumption of Wind Energy and Market Value

4 Oluwasola O. Ademulegun ^{1,*}, Patrick Keatley ², Motasem Bani Mustafa ³ and Neil J. Hewitt ⁴

5 ¹ Centre for Sustainable Technologies, University of Ulster, Jordanstown, BT37 0QB, Northern Ireland, UK;
6 ademulegun-o@ulster.ac.uk

7 ² Centre for Sustainable Technologies, University of Ulster, Jordanstown, BT37 0QB, Northern Ireland, UK;
8 p.keatley@ulster.ac.uk

9 ³ Centre for Sustainable Technologies, University of Ulster, Jordanstown, BT37 0QB, Northern Ireland, UK;
10 bani_mustafa-m@ulster.ac.uk

11 ⁴ Centre for Sustainable Technologies, University of Ulster, Jordanstown, BT37 0QB, Northern Ireland, UK;
12 nj.hewitt@ulster.ac.uk

13 * Correspondence: ademulegun-o@ulster.ac.uk; Tel.: +44-7747-238-873

14 Received: date; Accepted: date; Published: date

15 **Abstract:** Wind energy could be generated and captured with a storage device within the customer
16 premises for local utilization of the wind energy and for the provision of various services across the
17 electricity supply chain. To assess the benefits of adding a storage device to an electricity
18 distribution network that has two wind turbines with a base load of 500 kW and a typical peak load
19 under 1,500 kW, a 2MW/4MWh storage is installed. To observe the effects of adding the storage
20 device to the network, a technical analysis is performed using the *NEPLAN 360* modelling tool
21 while an economic analysis is carried out by estimating the likely payback period on investment. A
22 storage potential benefit analysis suggests how changes in integration policies could affect the
23 utility of adding the storage device. With the addition of the storage device, self-consumption of
24 wind energy increased by almost 10%. The profitability of the project increased when the device is
25 also deployed to provide stacked services across the electricity supply chain. Some policies that
26 permit the integration of devices into the grid could increase the profitability of storage projects.

27 **Keywords:** distributed energy resources; economics of storage; energy storage; self-consumption of
28 wind; storage services; wind energy

30 1. Introduction

31 The need for low-carbon energy systems in achieving energy sustainability has encouraged the
32 adoption of different techniques for increasing cleaner energy generation and utilization through
33 Distributed Energy Resources (DER). For instance, in the UK where a net-zero emission target has
34 been set [1] and in Northern Ireland where an increasing level of System Non-Synchronous
35 Penetration (SNSP) is to be achieved on the electricity grid [2], it is desirable to generate clean energy
36 from renewables like wind turbines. The variable nature of the renewables reduces their
37 effectiveness where the stability and reliability of the electricity grid is to be maintained. To address
38 the challenges in the variability of the renewables for a resilient grid, some solutions have been
39 proposed, namely demand-side energy management and the use of energy storage devices [3,4].

40 Integrating renewables and energy storage devices into the grid comes with challenges and
41 opportunities. The opportunities include optimal power management and economic benefits [5],
42 better utilization of relatively cheap renewable resources [6], increased consumption of the energy
43 produced from renewable sources [6], less pollution from energy production activities, and
44 reduction of the curtailments and constraints of renewables [7]. The storage could also be deployed
45 for stacked services in multi-use purposes [8,9].

46 The challenges in the integration include complex nature of the real benefits of storage, the
47 locational nature of the values for renewables and storage [10], the dynamics of storage economics,
48 and certain inconsistencies in policies that could discourage innovation. The peculiarities in the
49 characteristics of the aggregate power system within a region (the structure of the grid, the fuel mix
50 of the grid, the load profile of attached loads to the grid, the point on the grid where DER are to be
51 located, the availability of different energy sources, and the electricity market at the location) make
52 the value derivable from installing DER rather unique, typically varying from location to location
53 [10].

54 In [11], the market designs for and the characteristics of different ancillary services are
55 described with emphasis on the increasing role of DER in providing the ancillary services that have
56 historically been provided by conventional synchronous generators. The procurement schemes and
57 the emerging ancillary services that may be offered by the distributed resources are also described.
58 The roles that DER may play in decarbonization within the distribution network through the
59 provision of ancillary services have been described in [12]. In [13], a multi-source energy storage
60 model that consists of a conventional energy storage, a multi-energy flow resources, and a demand
61 response resource, at the demand and the supply sides, has been described for achieving economic
62 self-management of energy through an intelligent control management method. The integrated
63 distributed energy system was deployed to deal with the variability in loads and renewable supply.
64 In [14], an energy management system that maximizes renewable energy utilization while providing
65 certain ancillary services using heat pump and a thermal energy storage system has been reported to
66 help achieve cost saving, reduction of purchased energy imbalance from the grid, more reliable use
67 of the heat pump, and a more stable surrounding temperature.

68 This work investigates the use of an energy storage device for increasing self-consumption of
69 wind energy and providing market services within a distribution network having features given in
70 [15,16]. It is well known that energy storage techniques could be used to capture renewable energy
71 for a later use. However, there is a knowledge gap in ascertaining the real value of deploying the
72 storage at the specific locations having unique network, market, and policy characteristics.
73 Moreover, as reported in [17], it is often uneconomical to deploy storage devices at high investment
74 costs when the other possible storage application revenues are not considered. The work explores
75 the other value streams that could make deploying the storage device more profitable at the
76 distribution network. The addition of the storage device is modelled and technically analyzed using
77 the *NEPLAN 360* software while the economic feasibility of the storage project is assessed by
78 estimating the likely payback period on investment.

79 The local network is a campus site where the base load is 500 kW while the typical peak load is
80 below 1,500 kW. The distribution network has two behind-the-meter (BTM) wind turbines which are
81 connected to an alternating current electricity grid through an 11kV substation. Currently, any
82 excess energy production from the turbines is fed to the grid at a price fixed by the utility. Instead of
83 feeding the excess locally generated wind energy to the grid, the work examines installing a
84 2MW/4MWh storage device to capture the excess energy – to increase self-consumption of wind
85 energy while also using some capacity of the storage device for providing certain ancillary services
86 to the grid. As reported in [18], wind turbines could be deployed for providing grid services; in this
87 work, only the storage device is deployed for the grid services. To see how changes in policies could
88 impact the profitability of the project, a potential benefit analysis for adding the device is done using
89 an existing market structure.


90 **2. Materials and Methods**

91 *2.1. Description of Distribution Network*

92 To investigate how the energy storage device could be used to increase local consumption of
93 wind energy and provide certain ancillary services, a model of the distribution network is created

94 using the *NEPLAN 360* software. There are ten substations that feed different loads on-site. There are
 95 two grid-connected wind turbines running on-site.

96 The site is connected to the electricity grid via an 11kV feeder. From a typical one-year data of
 97 the site, a total energy of 3,720,642 kWh was imported from the grid. A total energy of 3,042,075 kWh
 98 was generated from the wind turbines. Whereas, 601,780 kWh – representing about 20% of the total
 99 energy generated from wind – was exported to the grid. The total annual energy consumption
 100 within the same one-year period was 6,189,647 kWh. The load profile depicts that of a campus site
 101 where the base load is 500 kW and the typical peak load is less than 1,500 kW, Figure 1.

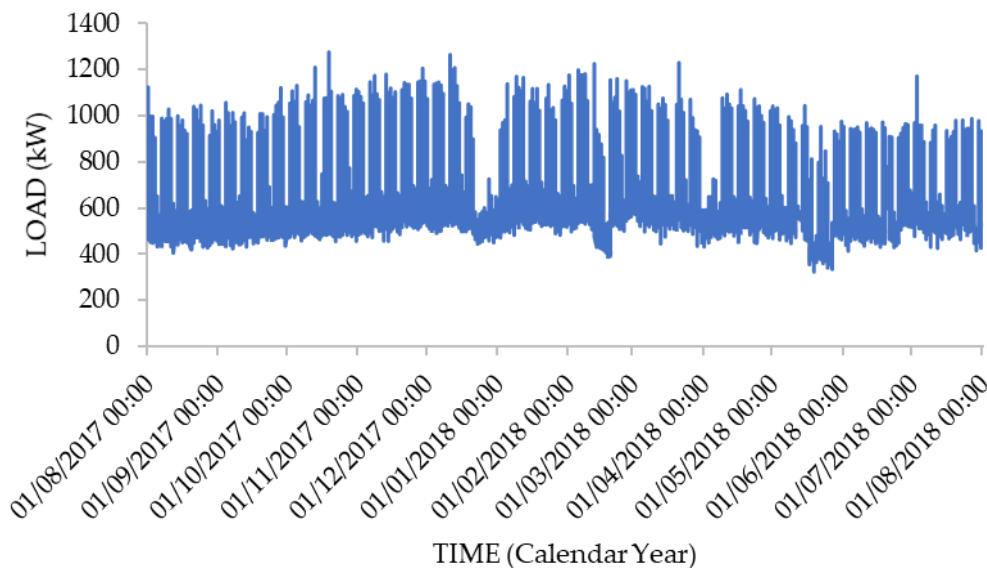


102

103

Figure 1. One Year (365-day) Load Profile of Site

104 A high voltage connection agreement puts the maximum energy that may be exported from the
 105 site to the grid (the maximum export capacity) at 1,242 kW; the maximum energy that may be
 106 imported from the grid to the site (the maximum import capacity) is 2,500 kW.

107 The line diagram of Figure 2 and Equation 1 both describe the initial configuration of the
 108 distribution network.

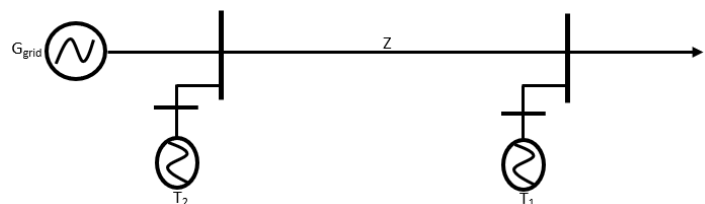

109

110

Figure 2. Line Diagram of Distribution Network


111

$$T_2 \pm G_{grid} = T_1 + Z + L \quad (1)$$

112 where L denotes the total power consumed in the aggregated system load, Z represents the total
 113 power expended in system impedances, T_1 represents the power supplied from the turbine number

114 one, G_{grid} represents the energy from the power grid, and T_2 represents the power supplied from the
 115 turbine number two.

116 The BTM energy storage device is installed to capture any excess energy generation from the
 117 wind turbines T_1 and T_2 . The network elements of the site are depicted in Figure 3.

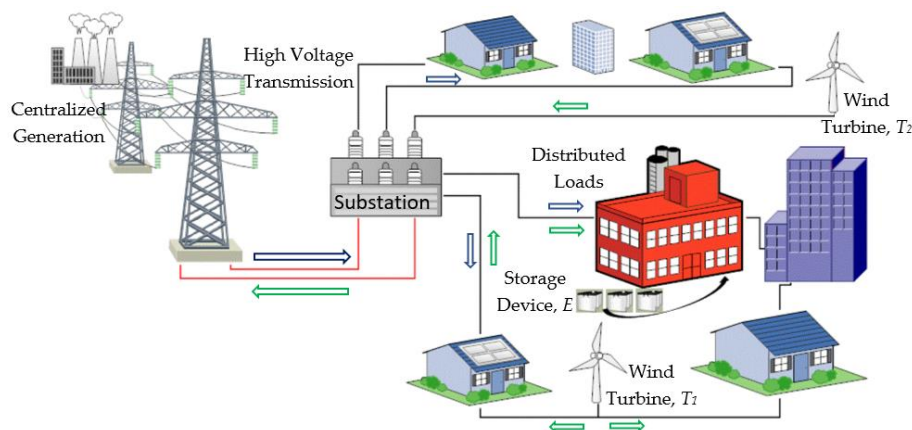

118
 119

Figure 3. Arrangement of Network Elements

120 Meanwhile, the loads in the local network are constantly linked to the grid for continuous
 121 power supply irrespective of the power output of the wind turbines. Rather than feeding the excess
 122 wind energy from the turbines to the grid, a storage device is installed on the network to take up the
 123 excess wind energy for later consumption on-site.

124 The data of the aggregate power produced from the turbines and a data of the maximum power
 125 demanded for the one-year period are used as the typical energy profiles of the site. During this
 126 period, the base load swung around 500 kW and the peak demand was 1,376 kW. The generation
 127 profiles of the wind turbines, the local load profile, and the total exported electricity data are used in
 128 estimating a suitable storage portfolio that could help in achieving the objectives of maximizing
 129 self-consumption of wind energy and providing market services. In other words, the power profiles
 130 of site within the same period (the power demand, the power generation, and the electricity
 131 import-export profiles) are used in ascertaining a suitable storage device – a storage technology that
 132 could meet the charge-discharge characteristics required. A cost analysis is carried out on some of
 133 the applicable storage technologies.

134 2.2. Storage Technologies

135 It is usually possible to find more than one suitable storage device for any storage project. The
 136 final device selection could be made based on any specific storage, utility, or user requirements. The
 137 account of the characteristics of different storage technologies, including the storage that may be
 138 suitable in a BTM application, are given in [19,20]. The technical characteristics of the different
 139 energy storage technologies and applications are presented in [21,22]. Some storage technologies
 140 possess interesting characteristics. Considering batteries for example: they are modular – they could
 141 be combined in modules to form small, medium, and large power banks. Such modularity of
 142 batteries and some other storage devices makes them rather suitable in BTM and customer-premise
 143 storage applications. Moreover, the battery could be sized to meet the exact user requirements,
 144 optimizing the use of resources. The other factors that are considered in selecting the storage device

145 for the BTM application include power requirement, charge-discharge requirement, duration of
 146 service required, operating temperature, space and location requirements, maintenance needs,
 147 maturity of the storage technology, and cost.

148 Some of the established storage options are considered for the project and a few of the most
 149 suitable technologies meeting the desired needs are selected for economic analysis; for example,
 150 flywheel storage and lithium ion (Li-ion) battery are considered.

151 2.3. Power Flow Analysis for Determining the Effect of Storage

152 To observe how the installation of the storage device will affect the distribution network, a
 153 power flow analysis is done. The network is considered operationally stable before the installation of
 154 the device. After installing the storage device, the network is observed to verify that installing the
 155 device has not compromised the stability and reliability of the distribution network.

156 Given that the real and the reactive power flowing into a bus i of a network is P and Q
 157 respectively, the static load flow equations used for network analysis could be expressed as:

$$158 \quad P_i = V_i \sum_{k=1}^n V_k Y_{ik} \cos(\theta_{ik} + \delta_k - \delta_i) \quad (2a)$$


$$159 \quad Q_i = -V_i \sum_{k=1}^n V_k Y_{ik} \sin(\theta_{ik} + \delta_k - \delta_i) \quad (2b)$$

160 where V_k is the voltage at bus k , Y_{ik} is the mutual admittance between the i th node and a k th node, n
 161 is the number of buses within the network, θ represents the phase angle between current and
 162 voltage, δ represents the load angle, and V_i represents the bus voltage.

163 Appendix contains a derivation of the load flow equations. The non-linear static load flow
 164 equations are solved numerically. The NEPLAN 360 modeller has a library of numerical solutions for
 165 technical power flow analysis. The modeller takes the network elements and their electrical
 166 parameters as inputs, uses a numerical method to analyse the power network, and outputs the
 167 electrical signals (current, voltage, power) at the network nodes and within the elements. It also
 168 indicates whether the numerical model converges or not and indicates where any excess power
 169 flows occur. With a model of the distribution network created, running a power flow reveals the
 170 changes to the network as a result of installing the storage device.

171 2.4. Power Management of Storage

172 The diagram of Figure 4 describes the final configuration of the distribution network.

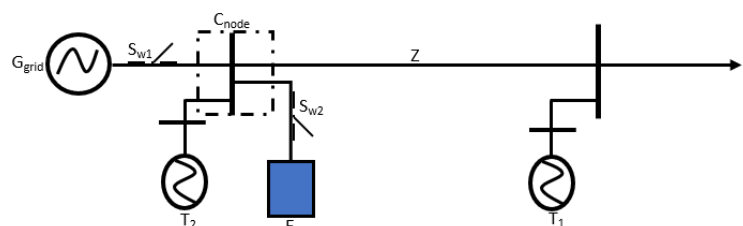

173

174

Figure 4. Adding Storage to Distribution Network

175 The switch S_{w1} links the distribution network to the grid. Equations (3a) and (3b) describe how the
 176 switch S_{w1} is to be operated.

$$S_{w1} = 1, \text{ when } L + Z > T_1 + T_2 + E_{(\min)} \quad (3a)$$

$$S_{w1} = 0, \text{ when } L + Z < T_1 + T_2 + E_{(\min)} \quad (3b)$$

where L denotes the energy demand by system load, Z represents the total energy expended in the system impedance, T_1 represents the energy feed from the turbine number one, T_2 represents the energy feed from the turbine number two, $E_{(\min)}$ represents the implied device discharge limit, and S_{w1} represents switch one.

The switch S_{w2} determines the time that the storage device E is to be charged or discharged; it is operated according to a control rule set at the C_{node} . Equation 4 describes the operation of the switch S_{w2} and the control at the C_{node} .

$$E_{(\min)} \propto [(E_{SOC}) \text{ AND } (E_{Services}) \text{ AND } (Time_{Tariff}) \text{ AND } (T_1) \text{ AND } (T_2)]$$

$$S_{w2} \propto E_{(\min)} = 1 \text{ OR } 0 \quad (4)$$

where T_2 represents the energy feed from the turbine number two, T_1 represents the energy feed from the turbine number one, $Time_{Tariff}$ is the instantaneous price of electricity, $E_{services}$ is the aggregate ancillary service demand on the storage device, E_{SOC} is any specified charging state of the device, $E_{(\min)}$ represents the implied device discharge limit, "AND" is a summing logic, S_{w2} represent switch two and "OR" is also a logical expression.

$$E_{(\min)}(1)^+ = E_{(\min)}(0)^+ \pm E_{(\min)}(1)^-$$

$$E_{(\min)}(2)^+ = E_{(\min)}(1)^+ \pm E_{(\min)}(2)^-$$

that is, $E_{(\min)}(t)^+ = E_{(\min)}(t-1)^+ \pm E_{(\min)}(t)^-$; for any discharge-limit instances $t = 1, 2, 3, \dots, n$

Switches S_{w1} and S_{w2} operate to ensure that the storage device is charged with a power supply from the wind turbines only. The switches ensure that the device is discharged to maximize self-consumption of the on-site-generated wind energy while also securing certain capacity of the device for the provision of any commitment to ancillary services.

2.5. Assessing the Benefit of Storage

A feature assessment of some storage technologies discussed in [19,20,21,22] is done to identify some of the storage options that could meet the defined objectives of maximizing self-consumption of wind energy and providing ancillary services. A cost analysis is carried out on the identified devices. The profitability of adding the storage device is determined taking the likely storage cost ranges, storage efficiencies, storage capacity, the electricity market, and the potential additional storage services as key parameters.

2.5.1. Benefits Through Self-consumption of Wind Energy

A benefit analysis is carried out to ascertain the gains in installing the storage device for increasing self-consumption of wind energy. The costs of energy storage systems are not fixed. Because of the dynamic nature of storage economics, in estimating the cost of storage, hypothesised

211 prices are used to reduce the effect of random errors that could arise from the use of a static price
212 quote. Using a price quote given at a time for an analysis invalidates any result from the analysis in a
213 new economic setting. Taking into cognizance the high likelihood of changes in the prices of some of
214 the storage technologies and with a broad study of the inconsistencies in price quotes from literature
215 and industry – for example, consider the different prices specified for the same storage technology
216 plus notes on cost inconsistencies in [14,19,22–32] – the most likely cost range for each of the storage
217 technologies is heuristically selected for analysis.

218 While the analysis is not claiming that any storage option is currently economical under the
219 existing market arrangement, the analysis aims to identify the cost point at which the storage
220 becomes economically feasible with respect to the distribution network and to reveal where changes
221 in market conditions or storage costs could impact the profitability of the storage project. The cost
222 range also makes it possible to apply the results of the analysis within any reasonable future changes
223 to the economics of storage.

224 Using an existing market system, the benefits of installing the storage device for increasing
225 self-consumption of wind energy is analysed. In the market, the price of import electricity and the
226 price of export electricity are in the ratio of 7 to 3 typically, the price of import electricity being often
227 higher: when the import electricity price is at £7/kWh, the exported electricity price will be around
228 £3/kWh. The prices could vary in different economic settings but have consistent relations – based
229 on the historical analysis of the site export-import payment data and in [33].

230 The benefit through self-consumption of wind energy is based on the difference between the
231 import and export electricity prices; the prices are fixed within days but could change when the
232 utility decides to review rates to reflect new economics. The total recoverable energy is obtained by
233 multiplying the captured (used to be exported) energy by the storage efficiency. The market value of
234 the recovered energy is obtained by multiplying the total recoverable energy by the market price.
235 The gross annual gain is the difference between the market value of the recovered energy at the
236 import electricity price and the market value of the exported energy at the export electricity price.

237 2.5.2. Benefits Through Market Services

238 In another case, in addition to helping to increase self-consumption of wind energy, certain
239 capacity of the storage device is committed to providing some services to the electricity grid through
240 *DS3/ISEM* [34,35,36] – *DS3* is a programme developed to increase the penetration of renewables like
241 wind on the power network, whereas *ISEM* is a cross-border electricity market that allows the
242 interconnection of grids for wholesale electricity trading.

243 The values from the actual provision of the ancillary services are not included because the
244 actual provision of the services is usually within very short times [18] and the exact amount of the
245 services provided may not be pre-determinable since the services are demanded by the electricity
246 grid only during special operating conditions, maintaining the stability of the grid. The value
247 accounted for here are only for the service “commitment,” and not for the actual performance: the
248 value derivable from connecting the storage device to the grid and making certain capacities
249 available for charging or discharging in supporting the grid during operational emergencies.

250 The services that the storage devices could provide are selected and aggregated from the *DS3*
251 service suite given in [36]. The service suite helps in maintaining the stability and reliability of the
252 grid as non-synchronous power sources increase with the integration of the variable renewables.

253 The service products are required to guarantee a qualitative performance of the grid. The products
 254 are described by the transmission network operators – *EirGrid* and *SONI* in [37,39] – with rates
 255 defined for specified times in [39]. The suite of services that a typical storage device could provide is
 256 summarised in Table 1 [40,41,42].

257 **Table 1.** Storage Eligible *DS3* Service Suite with Base Rates in £/MWh (2019-2020)

| Products | Abbreviation | Storage Eligible | Payment Rate (£/MWh) |
|---------------------------------------|--------------|------------------|----------------------|
| Fast Frequency Response | FFR | Yes | 1.98 |
| Primary Operating Reserve | POR | Yes | 2.97 |
| Ramping Margin 1 | RM1 | Yes | 0.11 |
| Ramping Margin 3 | RM3 | Yes | 0.16 |
| Ramping Margin 8 | RM8 | Yes | 0.15 |
| Replacement Reserve (De-Synchronised) | RRD | Yes | 0.51 |
| Replacement Reserve (Synchronised) | RRS | Yes | 0.23 |
| Secondary Operating Reserve | SOR | Yes | 1.80 |
| Tertiary Operating Reserve 1 | TOR1 | Yes | 1.42 |

258 While ancillary services were traditionally provided by equipment connected to the
 259 transmission network; in certain instances, the services could be provided through devices
 260 connected to the distribution network – this will usually depend on locational service needs, existing
 261 interconnection policies, and requires planning and coordination of network operations. The storage
 262 device could be restricted within certain limits in providing the services [42,43].

263 For this case of presenting the device for both maximizing self-consumption of wind energy
 264 and committing to providing certain ancillary services in stack, a new economic analysis is
 265 performed. The new analysis is to reveal how the commitment of the device to providing stacked
 266 market services impacts the profitability of the storage project. The total *DS3* service provided is the
 267 summation of the storage eligible *DS3* service suite of Table 1 – at the aggregated standard rate of
 268 £10.47/MWh.

269 20% of the storage capacity is committed within less than 2% of total lifespan of the storage
 270 device at the first instance, for the estimation of Gain 1 and the payback Period 1. The same storage
 271 capacity is committed for 25% of the device lifespan at the second instance, for the estimation of the
 272 Gain 2 and the payback Period 2. The ancillary service gain is a product of the committed capacity
 273 and the aggregated value, £10.47/MWh. The new annual gains are estimated as the sum of the gain
 274 from self-consumption of wind energy and the gain from the provision of ancillary services. It is
 275 assumed that committing the storage device to providing the ancillary services comes at zero or
 276 insignificant extra cost.

277 2.5.3. Potential Benefit Across Electricity Supply Chain

278 This section examines the value of the storage device installed on the described distribution
 279 network in general, not only the device deployed to capture the wind energy produced by BTM
 280 turbines. To account for the full range of values that could be derived from any typical installation, a
 281 potential benefit analysis is carried out for the entire stack of services that the storage device could
 282 potentially offer across the electricity supply chain.

283 In accounting for the potential storage benefits, with assumptions where required, the following
284 approximate daily storage service values are estimated:

- 285 • *DS3 Services*: the total suite of the *DS3* service that the storage device commits to is £10/MWh,
286 the size of the device deployed is 2MW/4MWh, 40% of the device capacity has been committed
287 to providing the services, the storage system has 85% roundtrip efficiency – the storage has
288 minimal energy losses while charging and discharging.
- 289 • *Increased Wind Self-consumption*: the size of the storage device is 2MW/4MWh, the device is
290 85% efficient (roundtrip), the site data – containing the import and the export electricity prices,
291 the energy exports from the wind turbines, the energy generated by the turbines, and the total
292 load energy required – are used in calculating the gross annual gain from self-consumption of
293 wind energy. The daily potential gain is estimated by dividing the gross annual gain by the
294 number of days in a year.
- 295 • *Time-of-Use-Bill-Management*: the size of the storage device is 2MW/4MWh; the device is 85%
296 efficient (roundtrip), the site data are used in calculating the mean daily import; using the *Power*
297 *NI* – an electricity supplier – *Economy 7* (2-Rate) meter plan [44], a third of the total electricity
298 required is set to be imported at a low rate period (at nights) while the remaining electricity is
299 imported at a high rate period (during the day).
- 300 • *Demand Response of Load Shifting*: the size of the storage device is 2MW/4MWh; the device is
301 85% efficient (roundtrip), the site data are used in calculating the mean daily import; using the
302 *SSE Airtricity* (an electricity supplier) *KeyPad Powershift* meter plan, a third of the total
303 electricity required for the day is imported within the “low” rate period – between 1:00 and 9:00
304 [45,46] while the remaining electricity is imported at the “normal” rate period during the day.

305 Some of the storage services highlighted are mutually exclusive; for example, while the storage
306 device has been deployed for increasing self-consumption of wind energy and providing certain
307 levels of ancillary services, the device may no longer be fully utilisable for
308 time-of-use-bill-management at the same time. While inadequate policies may not allow some
309 storage benefits to be realizable now, the potential benefit analysis is to indicate storage-utilisation
310 possibilities and reveal the changes in policies that could monetise additional storage values at the
311 distribution network.

312 Other potential storage values could be estimated for specific sites within the distribution
313 network. Meanwhile, any given application could require using a storage device with specific
314 characteristics.

315 **3. Results and Discussion**

316 While the on-site loads are supplied with the power generation from the wind turbines and the
317 grid, the installed storage device takes up any excess wind energy generation from the turbines as
318 the load flow converges while the network elements operate within safe limits, illustrated for a
319 typical windy day in Figure 5.

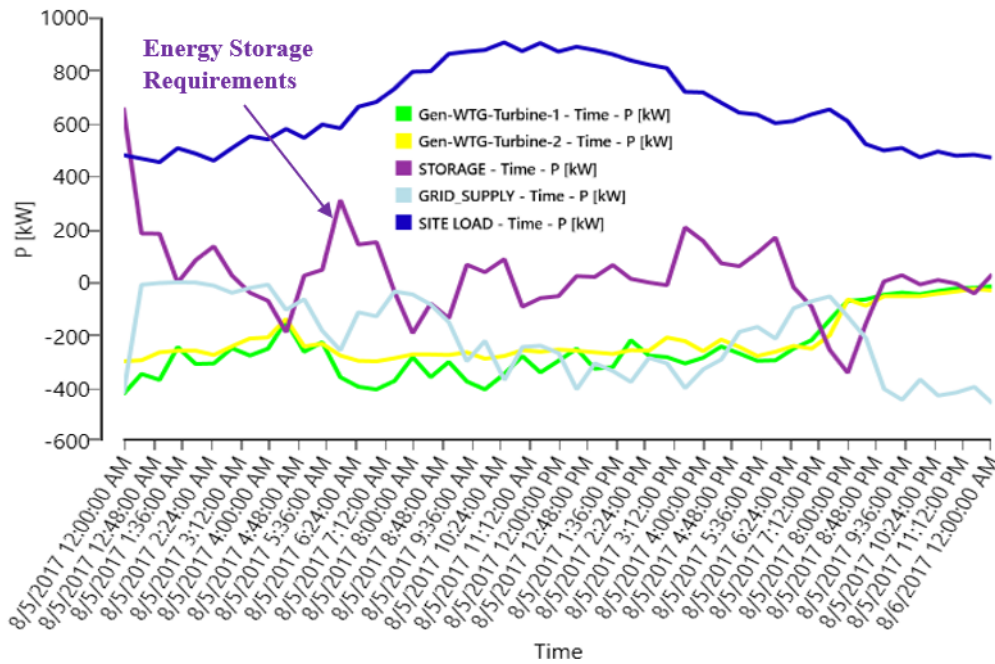


Figure 5. Energy Profiles for an Illustrative Day

320
321

322 The energy profile reveals the charge-discharge characteristics, suggesting applicable storage
 323 device, Figure 5. Between midnight (00:00 hour) and evening (18:00 hour), the aggregate power from
 324 the two wind turbines was close to 600 kW – a typically windy day. With the load demand rising
 325 from the base point at 500 kW, the loads are served from the turbines (with the excess wind
 326 generation and low demand at this time) and the storage device is discharged to meet the additional
 327 demand until at around the 4:30 hour when the energy generation from the turbines increases, the
 328 load demands being fully served and the excess wind energy charging the device through to around
 329 the 5:40 hour. As the load demand increases through the day, more energy is imported from the grid
 330 to supplement the energy generation from the turbines while the storage device is kept at a state of
 331 charge. At about the 20:00 hour, the wind energy generation drops; the battery is discharged as
 332 much as possible while the deficit in energy supply is met by the grid – the import from the grid
 333 moving close to 400 kW.

334 The profile indicates that the deployed storage device could be subject to daily multiple rounds
 335 of discharge cycles to achieve a maximum self-consumption of wind energy. This suggests that the
 336 deployed storage device should have the capability for several rounds of deep discharging.

337 Within the one-year period under consideration, while a 3,720,642 kWh of energy at a market
 338 value of £446,4777.04 (3,720,642 kWh * £0.12/kWh) was imported from the grid, a total energy of
 339 601,780 kWh at a market value of £31,593.45 (601,780 kWh * £0.0525/kWh) was exported to the grid.
 340 The total recoverable energy is obtained by multiplying the captured (used to be exported) energy
 341 (601,780 kWh) by the storage efficiency. The market value of the recovered energy has been obtained
 342 by multiplying the total recoverable energy by the market price of £0.12/kWh – the import and the
 343 export electricity prices are approximated from the historical analysis of the export and the import
 344 payments data. In [33], a similar price relation between the export electricity price and the import
 345 electricity price for grid-connected wind turbines on the foregoing distribution network may be
 346 seen. The gross annual gain shows the difference in market value at the import electricity price of
 347 £0.12/kWh and at the export electricity price of £0.0525/kWh, Table 2.

348

Table 2. Effect of Storage Efficiency on Total Recoverable Energy


| Efficiency of Storage System (%) | Total Recoverable Energy (kWh) | Market Value of Recovered Energy at £0.12/kWh (£) | Gross Annual Gain at £ (0.12-0.0525) /kWh (£) | Self-consumption of Wind Energy (%) |
|----------------------------------|--------------------------------|---|---|-------------------------------------|
| 95 | 571,691.00 | 68,602.92 | 37,009.47 | 48.89 |
| 90 | 541,602.00 | 64,992.24 | 33,398.79 | 48.40 |
| 85 | 511,513.00 | 61,381.56 | 29,788.11 | 47.91 |
| 80 | 481,424.00 | 57,770.88 | 26,177.43 | 47.42 |
| 75 | 451,335.00 | 54,160.20 | 22,566.75 | 46.93 |
| 70 | 421,246.00 | 50,549.52 | 18,956.07 | 46.45 |

349 The quantity of the recoverable energy is more when using a storage a device of higher
 350 efficiency – as less of the excess wind energy is wasted through the charge-discharge cycles with the
 351 higher efficiency storage system; for example, while a total energy of 571,691.00 kWh is recoverable
 352 when using a 95% efficient storage system, only a 421,246.00 kWh of energy is recoverable when
 353 using a 70% efficient storage system. In the existing market in which the import electricity price is
 354 £0.12/kWh and the export electricity price is £0.0525/kWh – taken as typical prices – the gross annual
 355 gain and the percentage of energy serving the loads from the storage device are more while using
 356 the high-efficiency storage system, Table 2. The result of Table 2 suggests that, to derive more gain
 357 from deploying a storage device for increasing self-consumption of the locally generated wind
 358 energy, a storage technology having a higher efficiency should be used.

359 Another important storage characteristic that should be considered is the operating
 360 temperature of the storage device in respect of its environment. For example, some battery
 361 performances may degrade while operating outside recommended temperature ranges. The mean
 362 annual temperature at this site over centuries have ranged from 8.5°C to 10.0°C, with a record
 363 extreme maximum temperature at 32.3°C and minimum temperature at -9.0°C [47,48]. The storage
 364 technologies selected can operate well within the site temperature range.

365 In other words, the storage technologies selected have typical roundtrip efficiencies above 65%,
 366 could meet the charge-discharge characteristics required, are mature or demonstrated technologies,
 367 have reasonable cost trends, have operating temperature features that make them appropriate at the
 368 site, are applicable at the point of the distribution network, and that could serve both as load and as
 369 generator. Of the considered storage technologies, flywheel storage, lithium ion battery, sodium ion
 370 (Na-ion) battery, and zinc-bromine (Zn-Br) flow battery are found to meet the storage requirements
 371 [19,20,21,22].

372 Considering the changes to the energy mix of the site: with the storage, no on-site generated
 373 wind energy is supplied to the grid – the storage captures the excess wind energy for
 374 self-consumption on-site. As depicted in Figure 6, the percentage of the wind energy in the energy
 375 mix at the location moved from 39.47% in Figure 6(a) to 48.32% in Figure 6(b) – an almost 10%
 376 increase in self-consumption of wind energy. The other part of the energy mix came from a grid
 377 supply with an average energy mix containing about 55% of the total energy generation coming
 378 from fossil fuel sources [15].

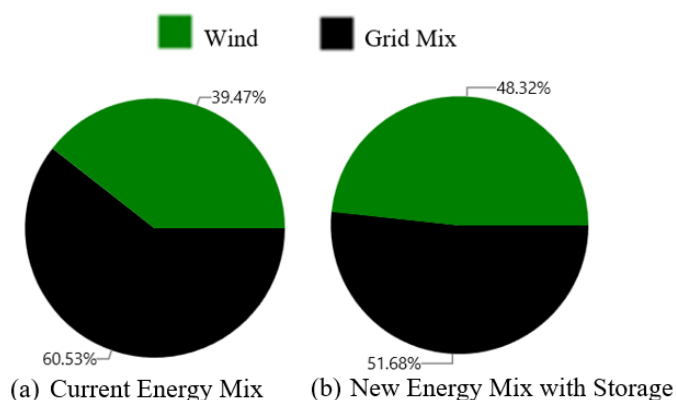

379

380

Figure 6. Energy Mix of Site

381 In analysing the value derived from deploying the storage device for self-consumption of wind
 382 energy: the total storage capacity cost is a total system cost – covering any cost associated with the
 383 acquisition, the installation, and the usage of the storage (including fixed cost, variable cost, capital
 384 cost, initial cost, maintenance cost, and any complementary costs). The cost ranges are heuristic
 385 test-case selections. The cost options help to see where the profitability of the storage project lies for
 386 different storage cost parameters that could typify varying market conditions, using a payback
 387 period estimation within the life span of the storage device.

388 Each of the storage technologies has been assigned a nominal storage efficiency; the values are
 389 the overall roundtrip efficiencies of the whole system of storage. The typical lifespan of a flywheel
 390 storage is taken to be above 20 years, the lithium ion and the sodium ion batteries are taken to have
 391 lifespans between 10 to 15 years, and the Zinc-bromine flow battery is considered to have lifespan of
 392 between 5 to 10 years [19,22]. The lifespans of the storage technologies are included to show where
 393 the technologies could make economic sense around the hypothesised prices. The payback period is
 394 the ratio of the cost of the total storage system to the gross annual gain of storage, Table 3.

395

Table 3. Deployment of Storage Device to Store Excess Wind Energy Only

| Selected Energy Storage Technologies and Costs (£/kW; £/kWh) | Total Storage Capacity Cost (£ Million) | Nominated Storage Efficiency (%) | Life Span (Years) | Gross Annual Gain (£) | Payback Period (Years) |
|--|---|----------------------------------|-------------------|-----------------------|------------------------|
| Flywheel at £120/kW; at £80/kWh | 0.56 | 90 | 20+ | 33,398.79 | 16.8 |
| Flywheel at £1,880/kW; at £1,715/kWh | 10.62 | 90 | 20+ | 33,398.79 | 318.0 |
| Li-ion Battery at £110/kW, at £70/kWh | 0.50 | 85 | 10-15 | 29,788.11 | 16.8 |
| Li-ion Battery at £1,580/kW, at £1,510/kWh | 9.20 | 85 | 10-15 | 29,788.11 | 308.8 |
| Na-ion Battery at £90/kW, at £60/kWh | 0.42 | 80 | 10-15 | 26,177.43 | 16.0 |
| Na-ion Battery at £1,200/kW, at £1,100/kWh | 6.80 | 80 | 10-15 | 26,177.43 | 259.8 |
| *Zn-Br Flow Battery at £105/kW, at £65/kWh | 0.47 | 75 | 5-10 | 22,566.75 | 20.8 |
| *Zn-Br Flow Battery at £1,150/kW, at £800/kWh | 5.50 | 75 | 5-10 | 22,566.75 | 243.7 |

396

*As most power equipment usually last for over 40 years, it is customary to evaluate new equipment within a

397

minimum of 10-year frame. Zn-Br Flow battery may not last for up to 10 years.

398 The results of Table 3 suggest that, with the current market conditions, the deployment of the
 399 2MW/4MWh energy storage device for self-consumption of wind energy could become
 400 economically feasible at the storage cost around £500,000. Given that the storage technologies have
 401 similar costs, flywheel storage promises higher return on investment because of its longer lifespan,
 402 inherent almost-unlimited cycles, and ruggedness in responding effectively to providing specialised
 403 electricity grid services. However, its considerable self-discharge rate could make it a less desirable
 404 choice for deferred self-consumption of stored energy [22]. Lithium ion battery could be a better
 405 option for being a more mature technology, being less susceptible to self-discharge, being able to
 406 withstand several rounds of deep discharging, and like most batteries, being able to respond in time
 407 to providing grid services [19].

408 While the results of Table 3 are for the case where the storage device has been deployed only for
 409 increasing self-consumption of wind energy, Table 4 depicts the result of deploying the device for
 410 providing certain *DS3* market services in addition to increasing self-consumption of wind energy.

411 **Table 4.** Deployment of Storage for Self-consumption of Wind Energy and Ancillary Services

| Selected Energy Storage Technologies and Costs (£/kW; £/ kWh) | Ancillary Services Duration/ Lifespan (%) | New Annual Gain 1 (£) | New Payback Period 1 (Years) | Ancillary Services Duration/ Lifespan (%) | New Payback Period 2 (Years) |
|---|---|-----------------------|------------------------------|---|------------------------------|
| Flywheel at £120/kW; at £80/kWh | 0.42 | 36,150.31 | 15.5 | 25 | 2.8 |
| Flywheel at £1,880/kW; at £1,715/kWh | 0.42 | 36,150.31 | 293.8 | 25 | 53.9 |
| Li-ion Battery at £110/kW, at £70/kWh | 0.56-0.83 | 32,126.90 | 15.6 | 25 | 3.9 |
| Li-ion Battery at £1,580/kW, at £1,510/kWh | 0.56-0.83 | 32,126.90 | 286.4 | 25 | 72.3 |
| Na-ion Battery at £90/kW, at £60/kWh | 0.56-0.83 | 28,048.42 | 15.0 | 25 | 3.5 |
| Na-ion Battery at £1,200/kW, at £1,100/kWh | 0.56-0.83 | 28,048.42 | 242.4 | 25 | 57.7 |
| *Zn-Br Flow Battery at £105/kW, at £65/kWh | 0.83-1.7 | 23,970.04 | 19.6 | 25 | 6.3 |
| *Zn-Br Flow Battery at £1,150/kW, at £800/kWh | 0.83-1.7 | 23,970.04 | 229.5 | 25 | 74.2 |

412 With the storage deployed for the multipurpose of increasing self-consumption of wind energy
 413 and providing the ancillary services, the results indicate a shorter payback period on investment,
 414 suggesting increased profitability. The total *DS3* service provided has been taken from the storage
 415 eligible *DS3* service suite of Table 1. The storage capacity is committed within less than 2% of total
 416 lifespan of the storage device at the first instance: estimates the new annual Gain 1 and the new
 417 payback Period 1. The same capacity is committed for 25% of the device total lifespan at the second
 418 instance: estimates a new Gain 2 and the new payback Period 2, Table 4. The new annual gain is the
 419 sum of the gain from self-consumption of wind energy and the gain from the provision of ancillary
 420 services.

421 The payback periods are shorter when the storage device is committed for longer duration. This
 422 suggests that, when deploying a storage device at the distribution network, it could be more
 423 profitable to commit the device to providing ancillary services to an extent permissible and that does
 424 not pose risk to the security of other investments serving the grid.

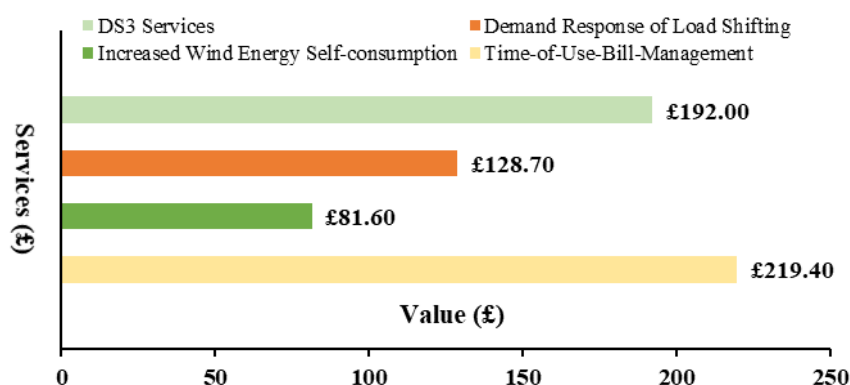


Figure 7. Potential Daily Revenue of Storage across Electricity Supply Chain

425
426

427 Another picture is depicted in Figure 7, where the daily potential value that the deployed
428 energy storage system could offer to stakeholders across the electricity supply chain has been
429 estimated using the approximate data described in section 2.5.3. While some of the potential values
430 such as demand charge reduction and increased wind self-consumption are concrete, others – such
431 as transmission and distribution deferrals – could be conceptual and often require favourable
432 integration policies and proper grid planning or coordination to become realizable.

433 Certain incentives could be available for generating and using more clean energy on-site; for
434 example, the revenue stream from the Renewable Obligation Certificate (ROC) that was in place to
435 promote renewable energy in Northern Ireland [33]. Similarly, some mechanisms that reduce
436 investment risks; for example, the Power Purchase Agreements (PPA) could serve to guarantee the
437 market for the storage services. The ROC and the PPA arrangements are typical market and
438 integration policies that could impact the value of any energy storage project.

439 Meanwhile, beyond the distribution network, some other storage benefits which are also
440 typically very site-specific could be derived while using the storage device for capturing or saving
441 energy for a later use. To mention a few: to manage the output of mass wind turbines where a
442 network congestion would have disallowed any further grid-integration of turbines, a storage
443 device could be installed for managed connection. The storage device could also be installed at the
444 higher voltage ends of the electricity network for energy arbitrage; for example, for bulk energy
445 trading during periods of high price volatility through the Irish *ISEM* intra-day market [35].

446 Lastly, a country-wide analysis could be performed to see how storage systems could be
447 deployed to support renewables and bring optimal benefits to the customer, to the grid, and to the
448 utility; maximizing renewable energy generation in achieving key sustainability targets.

449 4. Conclusions

450 Energy generation from wind turbines connected to the distribution network could contribute
451 to the effort of decarbonizing electricity systems. With storage devices, more of the on-site generated
452 wind energy could be captured for later energy consumption. For grid-connected systems, where
453 the market and integration policies permit it, the storage device could – in addition to providing
454 customer services – be committed to providing *DS3* services of active and reactive power, ramping
455 margins, and reserves. When a 2MW/4MWh storage device was deployed at a distribution network
456 having two 800KW BTM wind turbines, a typical peak load under 1,500 kW and a base load around
457 500 kW, the percentage of self-consumption of wind energy rose from 39.47% to 48.32%. Deploying
458 the device for providing other market services in addition to helping to achieve increased

459 self-consumption of wind energy makes the storage project more profitable – suggesting a
 460 mechanism through which the storage system could be deployed to contribute to the on-going effort
 461 of maximizing the utilization of clean energy for sustainable development. The profitability of the
 462 storage system deployed at the distribution network is dependent on the aggregate storage cost, the
 463 integration policies at the location, and the ability to deploy the device for stacked services. Through
 464 favourable integration and environment-cautious policies, energy storage could provide customer
 465 and ancillary services within the electricity supply chain.

466 **Author Contributions:** Conceptualization, Oluwasola O. Ademulegun, Patrick Keatley, Neil J. Hewitt;
 467 Methodology, Oluwasola O. Ademulegun; software, Oluwasola O. Ademulegun; writing—original draft
 468 preparation and editing, Oluwasola O. Ademulegun; writing—review, Patrick Keatley, Motasem Bani Mustafa,
 469 Neil J. Hewitt; supervision, Neil J. Hewitt, Patrick Keatley; funding acquisition, Neil J. Hewitt. All authors have
 470 read and agreed to the published version of the manuscript.

471 **Funding:** This research was funded by the Science Foundation Ireland (SFI) and the Department for the
 472 Economy (DfE) in Northern Ireland, grant number 92160R.

473 **Acknowledgments:** James Waide of the Physical Resources Department at Ulster University provided support
 474 while collecting data. Paul Bell of the Utility Regulator Northern Ireland supported in information gathering.
 475 The System Operator for Northern Ireland (SONI) and the Northern Ireland Electricity (NIE) Networks
 476 provided support in data collection.

477 **Conflicts of Interest:** The authors declare no conflict of interest. The funders had no role in the design of the
 478 study; in the collection, analyses, or interpretation of data; in the writing of the manuscript, or in the decision to
 479 publish the results.

480 Appendix

481 Static Load Flow Equations:

482 Given that the net complex power flowing into a bus i of a network is

$$483 \quad S_i = P_i + jQ_i = (P_{Gi} - P_{Di}) + j(Q_{Gi} - Q_{Di}) \quad (A1)$$

484 where P_D and Q_D are the real power demand and the reactive power demand respectively while P_G
 485 and Q_G are the real power generation and the reactive power generation within the bus respectively,

$$486 \quad P_i = P_{Gi} - P_{Di}$$

$$487 \quad Q_i = Q_{Gi} - Q_{Di} ; \text{ for } i = 1, 2, 3, \dots, n$$

488 If n represents the number of buses within the network, the flow of current through the bus i is

$$489 \quad I_i = \sum_{k=1}^n Y_{ik} V_k ; \text{ for } i = 1, 2, 3, \dots, n \quad (A2)$$

490 where V_k is the voltage at bus k , Y_{ik} is the mutual admittance – the admittance between the i th and the
 491 k th nodes; is the negative of the total admittances existing between the i th and k th nodes,

$$492 \quad \text{whereas } Y_{ik} = Y_{ki}$$

493 Similarly, the complex power flowing into a bus i is given as

$$494 \quad S_i = P_i + jQ_i = V_i I_i^* ; \text{ for } i = 1, 2, 3, \dots, n \quad (A3)$$

495 with I_i^* representing a complex conjugate of the current flow within the i th bus, and V_i representing
 496 the bus voltage,

$$497 \quad S_i^* = P_i - jQ_i = V_i^* I_i ; \text{ for } i = 1, 2, 3, \dots, n$$

$$S_i^* = P_i - jQ_i = V_i^* (\sum_{k=1}^n Y_{ik} V_k); \text{ for } i = 1, 2, 3, \dots, n \quad (\text{A4})$$

Now, if the real and the imaginary sections of Equation (A4) are correlated,

$$P_i = R_e\{V_i^* \sum_{k=1}^n Y_{ik} V_k\}; \quad Q_i = -I_m\{V_i^* \sum_{k=1}^n Y_{ik} V_k\}; \text{ for } i = 1, 2, 3, \dots, n \quad (\text{A5})$$

In polar form, $V_i = V_i \angle \delta_i$; $V_i^* = V_i \angle -\delta_i$; and $Y_{ik} = Y_{ik} \angle \theta_{ik}$; while θ represents the phase angle between current and voltage, δ represents the load angle.

Substituting the polar expressions for V_i^* , Y_{ik} , and V_k in Equation (A5); the real power and the reactive power components of the *static load flow equation* are respectively,

$$P_i = V_i \sum_{k=1}^n V_k Y_{ik} \cos(\theta_{ik} + \delta_k - \delta_i)$$

$$Q_i = -V_i \sum_{k=1}^n V_k Y_{ik} \sin(\theta_{ik} + \delta_k - \delta_i)$$

References

- UK Houses of Parliament. The Climate Change Act 2008 (2050 Target Amendment) Order 2019. The Stationery Office Limited under the authority and superintendence of Jeff James, Controller of Her Majesty's Stationery Office and Queen's Printer of Acts of Parliament, *Draft Statutory Instrument*, 2019.
- SONI. Strategy 2020-25: Transform the Power System for Future Generations. *Strategy 2020-2025 Report*, Available online: www.soni.ltd.uk, (accessed on 1 September 2019).
- Electric Power Research Institute. Time and Locational Value of DER: Methods and Applications. *EPRI Report 3002008410*, 2016; pp. 1–8.
- Olinsky-Paul, Todd. Energy Storage: The New Efficiency - How states can use energy efficiency funds to support battery storage and flatten costly demand peaks. *Clean Energy Group Report*, 2019; pp. 1–102.
- Pietrosanti, Stefano; Holderbaum, William; Becerra, V. M. Optimal Power Management Strategy for Energy Storage with Stochastic Loads. *Energies*, 2016, vol. 9, no. 3, pp. 1–17.
- Finn, P.; Fitzpatrick, C. Demand side management of industrial electricity consumption: Promoting the use of renewable energy through real-time pricing. *Appl. Energy*, 2014, vol. 113, pp. 1–11.
- EirGrid and SONI. Annual Renewable Energy Constraint and Curtailment Report 2018. *Report*, Available online: <http://www.eirgridgroup.com/site-files/library/EirGrid/Annual-Renewable-Constraint-and-Curtailment-Report-2018-V1.0.pdf> (accessed on 30 May 2019); pp. 1–26.
- Rocky Mountain Institute. The Economics of Battery Energy Storage - How Multi-use, Customer-sited Batteries Deliver the Most Services and Value to Customers and Grid. *Report*, Available online: <https://rmi.org/wp-content/uploads/2017/03/RMI-TheEconomicsOfBatteryEnergyStorage-FullReport-FIN-AL.pdf>, (accessed on 30 October 2019); pp. 14–16.
- Hartmann, Bálint; Vokony, István; Sorés, Péter; Táci, István. Service aspect assessment of energy storage under the ownership of distribution system operators. *Journal of Energy Storage*, 2019, vol 25.
- Fine, Steve; Martini, D. Paul; Succar, Samir; Robison, Matt. The Value in Distributed Energy: It's All About Location, Location, Location. ICF International *Whitepaper*, 2015, pp. 1–11.
- Oureilidis, Konstantinos; Kyriaki-Nefeli, Malamaki; Gallos, Konstantinos; Tsitsimelis, Achilleas; Dikaiakos, Christos; Gkavanoudis, Spyros; Cvetkovic, Milos; Mauricio, Manuel Juan; Ortega, Maza Maria Jose; Ramos, Luis Martinez Jose; Papaioannou, Georg; Demoulias, Charis. Ancillary Services Market Design in Distribution Networks: Review and Identification of Barriers. *Energies* 2020, 13(4), 917; <https://doi.org/10.3390/en13040917>.
- Maza-Ortega, M. José; Mauricio, M. Juan; Barragán-Villarejo, Manuel; Demoulias, Charis; Gómez-Expósito, Antonio. Ancillary Services in Hybrid AC/DC Low Voltage Distribution Networks. *Energies* 2019, 12(19), 3591; <https://doi.org/10.3390/en12193591>.

- 541 13. Wang, Weiliang; Wang, Dan; Liu, Liu; Jia, Hongjie; Zhi, Yunqiang; Meng, Zhengji; Du, Wei. Research on
542 Modeling and Hierarchical Scheduling of a Generalized Multi-Source Energy Storage System in an
543 Integrated Energy Distribution System. *Energies*, 2019, 12(2), 246; <https://doi.org/10.3390/en12020246>.
- 544 14. Bartolucci, Lorenzo; Cordiner, Stefano; Mulone, Vincenzo; Santarelli, Marina. Ancillary Services Provided
545 by Hybrid Residential Renewable Energy Systems through Thermal and Electrochemical Storage Systems.
546 *Energies* 2019, 12(12), 2429; <https://doi.org/10.3390/en12122429>.
- 547 15. EirGrid and SONI. All-Island Generation Capacity Statement: 2019-2028. Available online:
548 [http://www.soni.ltd.uk/media/documents/EirGrid-Group-All-Island-Generation-Capacity-Statement-201](http://www.soni.ltd.uk/media/documents/EirGrid-Group-All-Island-Generation-Capacity-Statement-2019-2028.pdf)
549 [9-2028.pdf](http://www.soni.ltd.uk/media/documents/EirGrid-Group-All-Island-Generation-Capacity-Statement-2019-2028.pdf), (accessed on 1 January 2020); pp. 1–78, 2019.
- 550 16. Northern Ireland Electricity Networks. NIE Networks RP6 Business Plan 2017-2024. *NIE Networks RP6*
551 *Report*, 2017.
- 552 17. Schmidt, Oliver; Melchior, Sylvain; Hawkes, Adam; Staffell, Iain. Projecting the Future Levelized Cost of
553 Electricity Storage Technologies. *Joule* 2019, 3, 81–100; <https://doi.org/10.1016/j.joule.2018.12.008>.
- 554 18. Rebello, E.; Watson, D.; Rodgers, M. Ancillary services from wind turbines: automatic generation control
555 (AGC) from a single Type 4 turbine. *Wind Energy Science* 2020, 5, 225–236;
556 <https://doi.org/10.5194/wes-5-225-2020>.
- 557 19. Aneke, M.; Wang, M. Energy storage technologies and real-life applications – A state of the art review.
558 *Appl. Energy*, 2016, vol. 179, pp. 350–377.
- 559 20. Sabihuddin, Siraj; Kiprakis, E. Aristides; Mueller, Markus. A Numerical and Graphical Review of Energy
560 Storage Technologies. *Energies*, 8(1), 2015, 172–216; <https://doi.org/10.3390/en8010172>.
- 561 21. Wonga, Ai Ling; Ramachandaramurthy, K. Vigna; Taylora, Phil; Ekanayake, J.B.; Walker, L. Sara;
562 Padmanaban, Sanjeevikumar. Review on the optimal placement, sizing and control of an energy storage
563 system in the distribution network. *Journal of Energy Storage*, 2019, vol 21, 489–504.
- 564 22. Koochi-Fayegh, S.; Rosen, M.A. A review of energy storage types, applications and recent developments.
565 *Journal of Energy Storage*, 2020, vol 27, 101047.
- 566 23. Balducci, J. Patrick; Alam, M. J. E.; Hardy, D. Trevor; Wu, Di. Assigning value to energy storage systems at
567 multiple points in an electrical grid. *Energy & Environmental Science Review*, 2018, DOI: 10.1039/c8ee00569a.
- 568 24. Li, Xin; Chalvatzis, J. Konstantinos; Stephanides, Phedeas. Innovative Energy Islands: Life-Cycle
569 Cost-Benefit Analysis for Battery Energy Storage. *Sustainability*, September 2018.
- 570 25. Barelli, Linda; Bidini, Gianni; Cherubini, Paolo; Micangeli, Andrea; Pelosi, Dario; Tacconelli, Carlo. How
571 Hybridization of Energy Storage Technologies Can Provide Additional Flexibility and Competitiveness to
572 Microgrids in the Context of Developing Countries. *energies*, August 2019.
- 573 26. Bradbury, Kyle. Energy Storage Technology Review. *Review*, Available online:
574 <https://www.kylebradbury.org/docs/papers/Energy-Storage-Technology-Review-Kyle-Bradbury-2010.pdf>
575 [f](https://www.kylebradbury.org/docs/papers/Energy-Storage-Technology-Review-Kyle-Bradbury-2010.pdf), (accessed on 30 October 2019).
- 576 27. Lazard. Lazard's Levelized Cost of Storage Analysis – Version 3.0. *Technical Report*, Available online:
577 <https://www.lazard.com/media/450338/lazard-levelized-cost-of-storage-version-30.pdf>, (accessed on 30
578 October 2019).
- 579 28. ADB. Handbook on Battery Energy Storage System. Asian Development Bank *Book*, ISBN
580 978-92-9261-470-6 (print), 978-92-9261-471-3 (electronic), Publication Stock No. TCS189791-2, December
581 2018, DOI: <http://dx.doi.org/10.22617/TCS189791-2>.
- 582 29. IRENA. Electricity Storage and Renewables: Costs and Markets To 2030. International Renewable Energy
583 Agency, Abu Dhabi *Report*, ISBN 978-92-9260-038-9, 2017.
- 584 30. Electric Power Research Institute. Electricity Energy Storage Technology Options: Applications, Costs, and
585 Benefits. *A White Paper Primer* 1020676, 2011; pp. 1–170.
- 586 31. U.S. Department of Energy. Grid Energy Storage. *Report on grid energy storage*, December 2013.
- 587 32. Goldie-Scot, Logan. A Behind the Scenes Take on Lithium-ion Battery Prices. BloombergNEF *Article*,
588 Available online: <https://about.bnef.com/blog/behind-scenes-take-lithium-ion-battery-prices/>, (accessed
589 on 1 January 2020).
- 590 33. Invest Northern Ireland. Wind Power: A best practice guide for Northern Ireland business. *Sustainable*
591 *Development – Team Text Relay*, Number: 1800102890698273, Available on:
592 [https://secure.investni.com/static/library/invest-ni/documents/wind-power-a-best-practice-guide-for-busi](https://secure.investni.com/static/library/invest-ni/documents/wind-power-a-best-practice-guide-for-businesses-in-northern-ireland.pdf)
593 [nesses-in-northern-ireland.pdf](https://secure.investni.com/static/library/invest-ni/documents/wind-power-a-best-practice-guide-for-businesses-in-northern-ireland.pdf), (accessed on 1 January 2020); pp 26–86.

- 594 34. SEM Committee. Quick Guide to I-SEM. Available online:
595 https://www.semcommittee.com/sites/semc/files/media-files/ISEM%20quick%20guide_1.pdf,
596 (accessed on 1 January 2020); pp 1–11.
- 597 35. EirGrid. Quick Guide to the Integrated Single Electricity Market; the I-SEM Project version, pp. 1–11,
598 Available online:
599 http://www.eirgridgroup.com/_uuid/f110639e-9e21-4d28-b193-ed56ee372362/EirGrid-Group-I-SEM-Quick-Guide.pdf, (accessed on 1 January 2020).
- 600 36. EirGrid and SONI. FlexTech Consultation 2019, A Flexible Technology Integration Initiative. Available
601 online: http://www.soni.ltd.uk/media/documents/FlexTech-Consultation_30092019.pdf, (accessed on 1
602 January 2020); pp. 1–21.
- 603 37. EirGrid and SONI. DS3 System Services: Portfolio Capability Analysis. Available online:
604 [http://www.eirgrid.ie/site-files/library/EirGrid/DS3-System-Services-Portfolio-Capability-Anal-](http://www.eirgrid.ie/site-files/library/EirGrid/DS3-System-Services-Portfolio-Capability-Analysis.pdf)
605 [ysis.pdf](http://www.eirgrid.ie/site-files/library/EirGrid/DS3-System-Services-Portfolio-Capability-Analysis.pdf), (accessed on 1 January 2020); pp. 1–15.
- 606 38. EirGrid and SONI. DS3 System Services Scalar Design. Available online:
607 [http://www.eirgridgroup.com/site-files/library/EirGrid/OPI_INN_DS3-System-Services-Scalar-](http://www.eirgridgroup.com/site-files/library/EirGrid/OPI_INN_DS3-System-Services-Scalar-DesignFinal_231017.pdf)
608 [DesignFinal_231017.pdf](http://www.eirgridgroup.com/site-files/library/EirGrid/OPI_INN_DS3-System-Services-Scalar-DesignFinal_231017.pdf), (accessed on 1 January 2020); pp. 1–64.
- 609 39. EirGrid and SONI. DS3 System Services Interim Tariffs DECISION PAPER. Available online:
610 [http://www.eirgridgroup.com/site-files/library/EirGrid/DS3-System-Services-Decision-Paper-o-](http://www.eirgridgroup.com/site-files/library/EirGrid/DS3-System-Services-Decision-Paper-on-Interim-Tariffs-FINAL.pdf)
611 [n-Interim-Tariffs-FINAL.pdf](http://www.eirgridgroup.com/site-files/library/EirGrid/DS3-System-Services-Decision-Paper-on-Interim-Tariffs-FINAL.pdf), (accessed on 1 January 2020); pp. 36.
- 612 40. SONI. DS3 System Services Statement of Payments. *Statement of Payment*. Available online:
613 <http://www.soni.ltd.uk/media/documents/DS3-SS-Statement-of-Payments-2019-20.pdf>, (accessed on 1
614 January 2020).
- 615 41. EirGrid and SONI DS3 System Services Market Ruleset Recommendation Paper. Available online:
616 [http://www.eirgridgroup.com/site-files/library/EirGrid/DS3-System-Services-Market-Ruleset-Recommen-](http://www.eirgridgroup.com/site-files/library/EirGrid/DS3-System-Services-Market-Ruleset-Recommendations-Paper-16052018.pdf)
617 [dations-Paper-16052018.pdf](http://www.eirgridgroup.com/site-files/library/EirGrid/DS3-System-Services-Market-Ruleset-Recommendations-Paper-16052018.pdf), (accessed on 1 January 2020); pp 1–28.
- 618 42. EirGrid and SONI. DS3 System Services Tariffs for Regulated Arrangements. Available online:
619 [http://www.eirgridgroup.com/site-files/library/EirGrid/OPI_INV_DS3-System-Services-Tariffs-for-Regula-](http://www.eirgridgroup.com/site-files/library/EirGrid/OPI_INV_DS3-System-Services-Tariffs-for-Regulated-Arrangements-FINAL-23.10.2017.pdf)
620 [ted-Arrangements-FINAL-23.10.2017.pdf](http://www.eirgridgroup.com/site-files/library/EirGrid/OPI_INV_DS3-System-Services-Tariffs-for-Regulated-Arrangements-FINAL-23.10.2017.pdf), (accessed on 1 January 2020); pp. 15–18.
- 621 43. EirGrid and SONI. Consultation on Connecting Further Generation in Northern Ireland. 2018;
622 pp. 39–44.
- 623 44. Power NI. Unit Rate Prices. Plans & Discounts *Article*, Available online:
624 <https://powerni.co.uk/plan-prices/compare-our-plans/tariff-rates/>, (accessed on 1 January 2020).
- 625 45. SSE Airtricity. Our Tariffs. Plans & Products *Article*, Available online:
626 <https://www.sseairtricity.com/uk/home/help-centre/our-tariffs>, (accessed on 1 January 2020).
- 627 46. SSE Airtricity. 1 Year Keypad Electricity Tariffs. *Tariff Quote Document*, Available online:
628 <https://www.sseairtricity.com/assets/Tariffs/ElecNI/Oct-19/1YR-KEYPAD-9.pdf>, (accessed on 1
629 January 2020).
- 630 47. Kendon, Mike; McCarthy, Mark; Jevrejeva, Svetlana. State of the UK Climate 2014. Met Office
631 Hadley Centre & National Oceanography Centre *Report*, July 2014.
- 632 48. Met Office Hadley Centre. UK Climate Projections: Headline Findings. Met Office *Report*
633 version 2, September 2019.
- 634
635



© 2020 by the authors. Submitted for possible open access publication under the terms and conditions of the Creative Commons Attribution (CC BY) license (<http://creativecommons.org/licenses/by/4.0/>).